

SITE SPECIFIC DATA

Pipe

PERFORMANCE SPECIFICATIONS

NJDEP 80% Removal, 75 micron 0.384 cfs

Type

ID

NA

Invert

Elevation

0.341 cfs

NA

Structure ID

Rim Elevation

Pipe Data

Outlet Notes:

Treatment Flow Rate (cfs)

Pipe

Treatment Flow Capacities:

Location Size


WA Ecology GULD - Basic,

Contact Oldcastle for alternative treatment flow capacities.

Enhanced & Phosphorus

Bypass Capacity

Peak Flow Rate (cfs)

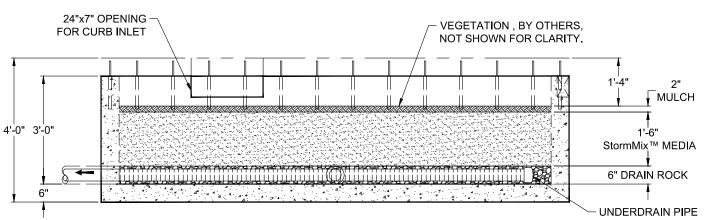

LEFT END VIEW **ELEVATION VIEW**

NOTES:

- 1. DESIGN LOADINGS:
 - A. 300 PSF PEDESTRIAN LOADING
 - B. DESIGN SOIL COVER: 0' MAXIMUMC. ASSUMED WATER TABLE: BELOW BASE OF (ENGINEER-OF-RECORD TO CONFIRM SITE
 - WATER TABLE ELEVATION)

 D. LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
 - E. LATERAL LIVE LOAD SURCHARGE: 80 PSF
 - (APPLIED TO 8-0" BELOW GRADE)

 F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
- 2. CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
- 3. REINFORCING: REBAR, ASTM A615/A706, GRADE 60
- 4. CEMENT: ASTM C150
- 5. REQUIRED ALLOWABLE SOIL BEARING CAPACITY:
- 6. REFERENCE STANDARD:
 - A. ASTM C890
 - B. ASTM C913
- C. ACI 318-14
- 7. THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN. ENGINEER-OF-RECORD SHALL VERIFY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON
- INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS CAN BE MIRRORED.
- CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
- 10. CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
- 11. SECTION HEIGHTS, SLAB/WALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
- 12. MAXIMUM PICK WEIGHTS":
 - A. BASE: XX,XXX LBS* (* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA)
- 13. INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, AND MULCH.



Ph: 800.579.8819 | www.oldcastleinfrastructure.com/stormwater HIS DOCUMENT IS THE PROPERTY OF OLDCASTLE INFRASTRUCTURE, I S CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY HALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, ITHOUT THE WRITTEN PERMISSION OF OLDCASTLE INFRASTRUCTURE, PYRIGHT © 2021 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERV

BioPod™ Biofilter System

Planter Vault with External Bypass

PROJECT NAME

Specifier Drawing BPP-812EB

1 OF 1 REV DATE

(STANDARD