


SITE SPECIFIC DATA				
Structure ID				ID
Treatment Flow Rate (cfs)				-
Peak Flow Rate (cfs)				-
Rim Elevation				-
Pipe Data	Pipe Location	Pipe Size	Pipe Type	Invert Elevation
Outlet	-	-	-	-
Notes:				
PERFORMANCE SPECIFICATIONS				
Treatment Flow Capacities:				
NJDEP 80% Removal, 75 micron				0.083 cfs
WA Ecology GULD - Basic, Enhanced & Phosphorus				0.074 cfs
Bypass Capacity				2.0 cfs


\*Contact Oldcastle for alternative treatment flow capacities

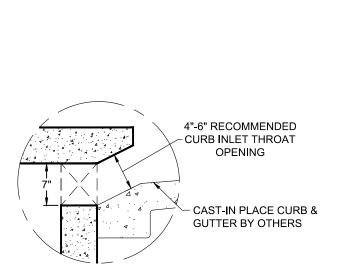

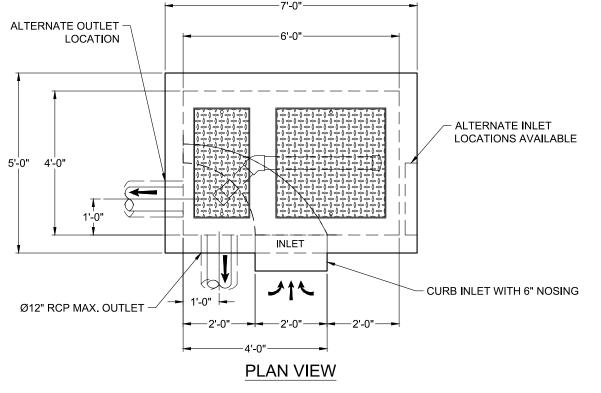

## **CURB INLET DETAIL**



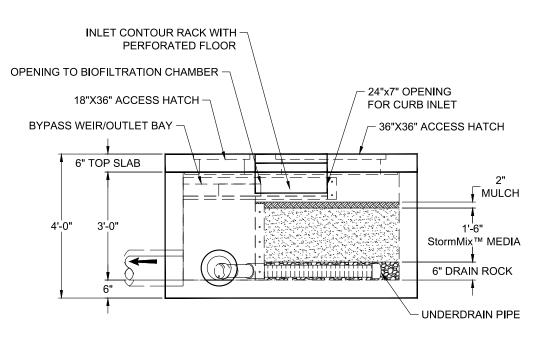

**LEFT END VIEW** 

**ELEVATION VIEW** 

## NOTES:

- 1. DESIGN LOADINGS:
  - A. 300 PSF PEDESTRIAN LOADING
  - B. DESIGN SOIL COVER: 0' MAXIMUM
    C. ASSUMED WATER TABLE: BELOW BASE OF (ENGINEER-OF-RECORD TO CONFIRM SITE
  - WATER TABLE ELEVATION)
    D. LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
  - E. LATERAL LIVE LOAD SURCHARGE: 80 PSF
  - (APPLIED TO 8-0" BELOW GRADE)

    F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
- 2. CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
- 3. REINFORCING: REBAR, ASTM A615/A706, GRADE 60
- 4. CEMENT: ASTM C150
- 5. REQUIRED ALLOWABLE SOIL BEARING CAPACITY:
- 6. REFERENCE STANDARD:
  - A. ASTM C890
  - B. ASTM C913
- C. ACI 318-14
- 7. THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN. ENGINEER-OF-RECORD SHALL VERIFY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON
- INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS
- CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
- 10. CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
- 11. SECTION HEIGHTS, SLAB/WALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
- 12. MAXIMUM PICK WEIGHTS":

  - A. TOP: XX,XXX LBS
    B. BASE: XX,XXX LBS\* (\* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA)
- 13. INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, MULCH, AND INLET CONTOUR RACK



PIL 300,579-36 T9 | WWW.000castierimasticulier.com/solimitater
IIS DOCUMENT IS THE PROPERTY OF OLDCASTLE INFRASTRUCTURE, I
IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY A
HALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF,
ITHOUT THE WRITTEN PERMISSION OF OLDCASTLE INFRASTRUCTURE, I PYRIGHT © 2021 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERV

BioPod™ Biofilter System

Surface Vault with Internal Bypass

(STANDARD

1 OF 1

PROJECT NAME

Specifier Drawing REV DATE BPS-46IB

