

SITE SPECIFIC DATA						
Structure	ID					
Treatment	-					
Peak Flow	NA					
Rim Eleva	•					
Pipe Data	Pipe Location	Pipe Size	Pipe Type	Invert Elevation		
Outlet	-	-	-	-		

ΝI	O.	DC.	
V	v	LCS.	

PERFORMANCE SPECIFICATIONS				
Treatment Flow Capacities:				
NJDEP 80% Removal, 75 micron	0.064 cfs			
WA Ecology GULD - Basic,	0.057 cfs			
Enhanced & Phosphorus				
Bypass Capacity	NA			
*Contact Oldcastle for alternative treatment flow capacities.				

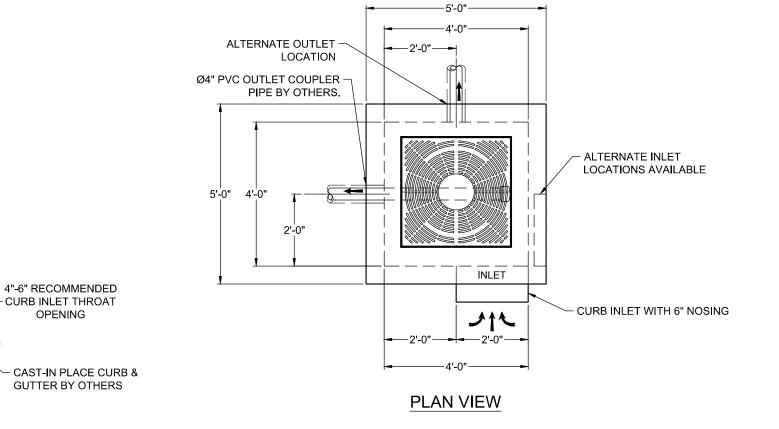

CURB INLET DETAIL



24"x7" OPENING
FOR CURB INLET

36"X36" TREE GRATE

2"

MULCH

1'-6"
StormMix™ MEDIA

6" DRAIN ROCK

UNDERDRAIN PIPE

LEFT END VIEW

ELEVATION VIEW

NOTES:

- DESIGN LOADINGS:
 - A. 300 PSF PEDESTRIAN LOADING
 - B. DESIGN SOIL COVER: 0' MAXIMUM
 C. ASSUMED WATER TABLE: BELOW BASE OF PRECAST
 (ENGINEER-OF-RECORD TO CONFIRM SITE
 - WATER TABLE ELEVATION)

 D. LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
 - E. LATERAL LIVE LOAD SURCHARGE: 80 PSF (APPLIED TO 8'-0" BELOW GRADE)
 - F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
- 2. CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
- 3. REINFORCING: REBAR, ASTM A615/A706, GRADE 60
- 4. CEMENT: ASTM C150
- 5. REQUIRED ALLOWABLE SOIL BEARING CAPACITY:
- 6. REFERENCE STANDARD:
 - A. ASTM C890
 - B. ASTM C913
 - C. ACI 318-14
- 7. THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN.
 ENGINEER-OF-RECORD SHALL VERIFY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON
- 8. INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS CAN BE MIRRORED.
- CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
- CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
- 11. SECTION HEIGHTS, SLAB/WALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
- 12. MAXIMUM PICK WEIGHTS":
 - A. TOP: XX,XXX LBS
 B. BASE: XX,XXX LBS*
 - (* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA)
- INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, AND MULCH.



Ph: 800.579.8819 | www.oldcastleinfrastructure.com/stormwater
HIS DOCUMENT IS THE PROPERTY OF OLDCASTLE INFRASTRUCTURE. IN
IT IS CONFIDENTIAL. SUBMITTED FOR REFERENCE PURPOSES ONLY ANI
SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OF
WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE INFRASTRUCTURE, INC.
COPYRIGHT © 2021 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVEL

BioPod™ Biofilter System

(STANDARD

Tree vault with External Bypass

CUSTOMER

PROJECT NAME

JECT NAME

NAME REVISION

Specifier Drawing BPT-44EB REV DATE 1 OF 1