
SITE SPECIFIC DATA				
ID			ID	
Treatment Flow Rate (cfs)			-	
Peak Flow Rate (cfs)			-	
ition			-	
Pipe Location	Pipe Size	Pipe Type	Invert Elevation	
	ID t Flow Rate / Rate (cfs) tion	ID t Flow Rate (cfs) Rate (cfs)	ID t Flow Rate (cfs) Rate (cfs) tion	

Notes:

PERFORMANCE	CDECIEICATION
PERFURINANCE	SPECIFICATION

Treatment Flow Capacities:		
NJDEP 80% Removal, 75 micron	0.115 cfs	
WA Ecology GULD - Basic, Enhanced & Phosphorus	0.103 cfs	
Bypass Capacity	2.0 cfs	
*Contact Oldcastle for alternative treatment flow capacities.		

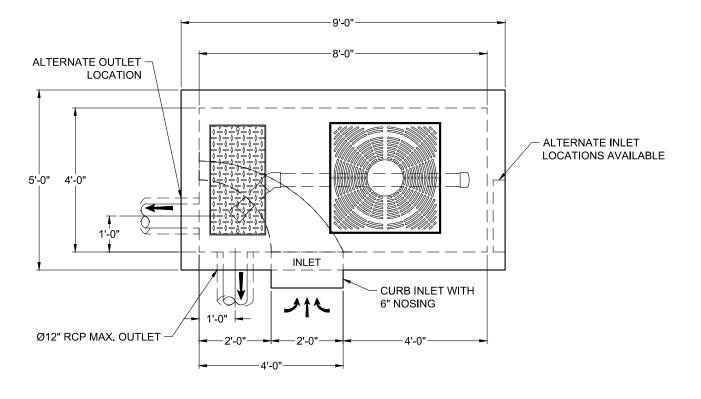

PLAN VIEW


CURB INLET DETAIL


4"-6" RECOMMENDED

CURB INLET THROAT

OPENING

CAST-IN PLACE CURB & **GUTTER BY OTHERS**



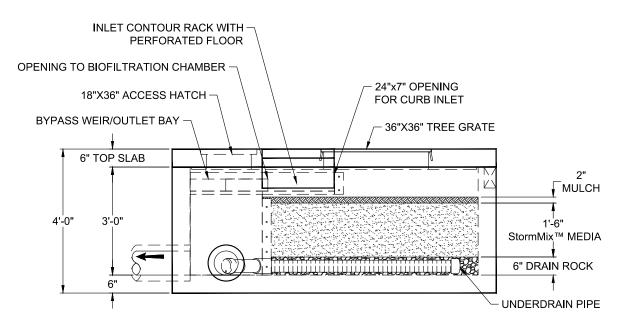

LEFT END VIEW

ELEVATION VIEW

NOTES:

- 1. DESIGN LOADINGS:
 - A. 300 PSF PEDESTRIAN LOADING
 - B. DESIGN SOIL COVER: 0' MAXIMUM
 C. ASSUMED WATER TABLE: BELOW BASE OF (ENGINEER-OF-RECORD TO CONFIRM SITE
 - WATER TABLE ELEVATION)
 D. LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
 - E. LATERAL LIVE LOAD SURCHARGE: 80 PSF
 - (APPLIED TO 8'-0" BELOW GRADE)

 F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
- 2. CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
- 3. REINFORCING: REBAR, ASTM A615/A706, GRADE 60
- 4. CEMENT: ASTM C150
- 5. REQUIRED ALLOWABLE SOIL BEARING CAPACITY:
- 6. REFERENCE STANDARD:
 - A. ASTM C890
 - B. ASTM C913
 - C. ACI 318-14
- 7. THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN. ENGINEER-OF-RECORD SHALL VERIFY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON
- INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS CAN BE MIRRORED.
- CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
- 10. CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
- 11. SECTION HEIGHTS, SLAB/WALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
- 12. MAXIMUM PICK WEIGHTS":
 - A. TOP: XX,XXX LBS
 B. BASE: XX,XXX LBS*
 - (* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA)
- 13. INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, MULCH, AND INLET CONTOUR RACK



Ph: 800.579.8819 | www.olocastleinfrastructure.com/stomwater HIS DOCUMENT IS THE PROPERTY OF DLOCASTLE INFRASTRUCTURE, IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY HALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, ITHOUT THE WRITTEN PERMISSION OF OLDCASTLE INFRASTRUCTURE, PYRIGHT © 2021 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERV

BioPod™ Biofilter System

Tree vault with Internal Bypass

PROJECT NAME

Specifier Drawing BPT-48IB

1 OF 1 REV DATE

(STANDARD

