


PLAN VIEW
SCALE: 1" = 1'-0"

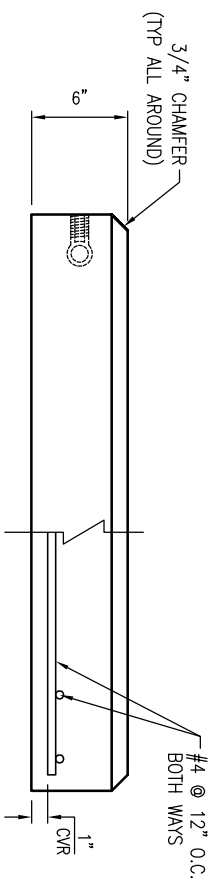


VIEW A
SCALE: 1" = 1'-0"

1. USE EXACT BAR SIZE AND SPACING AS NOTED ABOVE.
2. ALL STEEL CUT OUT FOR OPENINGS WILL BE REPLACED. HALF REINFORCEMENT ON EACH SIDE OF OPENING. INCLUDE (2) ADDITIONAL #4 DIAGONAL BARS AROUND OPENING (SEE TYPICAL REINFORCEMENT FOR ALL OPENINGS)

REVISIONS

REV	DATE	BY	SHEET	DESCRIPTION OF REVISION	REQUESTED BY
A					
B					
C					
D					

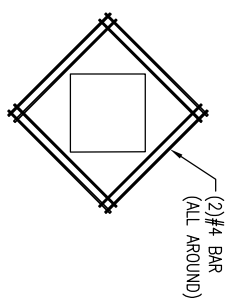

TYPICAL REINFORCEMENT FOR OPENINGS
SCALE: N.T.S.

THIS MUST BE FILLED OUT BEFORE MANUFACTURING BEGINS.

APPROVED W/ NO EXCEPTIONS TAKEN:


APPROVED AS NOTED:

REVISED AND RESUBMIT:

SIGNATURE: _____ DATE: _____

GENERAL NOTES:

1. CONCRETE: 28 DAY COMPRESSIVE STRENGTH F_c = 4,500 PSI (MIN).
2. REINFORCING: ASTM A-615, GRADE 60.
3. SLAB DESIGNED FOR 144-216 FONZ CABINET LOAD ONLY.
4. SLAB DESIGNED FOR 150 MPH WIND LOAD, IN ACCORDANCE WITH ASCE 7-10.
5. SLAB SHALL BE SUPPORTED IN ACCORDANCE WITH AT&T PROJECT SPECIFICATIONS (I.E. LEVEL AND COMPACTED BEARING SURFACE).

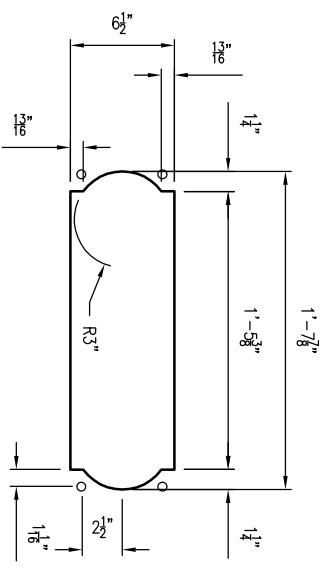

BLOCKOUT DETAIL
SCALE: 1" = 1'-0"

SECTION	WEIGHT (lbs)	CONCRETE (CY)
6" SLAB	625	0.15



THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL. SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT © 2015 OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED.

3X3' OD POWER PEDESTAL PAD
SUBMITTAL LAYOUT

CUSTOMER
AT & T (PIN# ATT: 100060366)

DATE	SALES	DRAWN	ENGINEER	CHECKED	SALES ORDER
3/18/15	LD				
DRAWING NUMBER	REV	DATE	REV	DATE	SHEET
33-PWR-Pd					1 OF 1

