
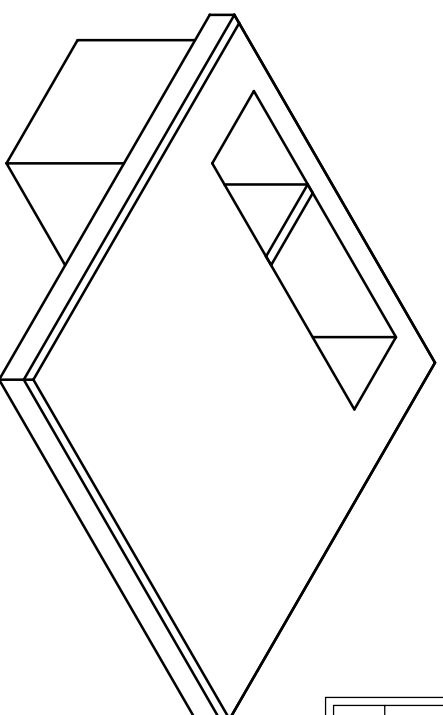



PLAN VIEW

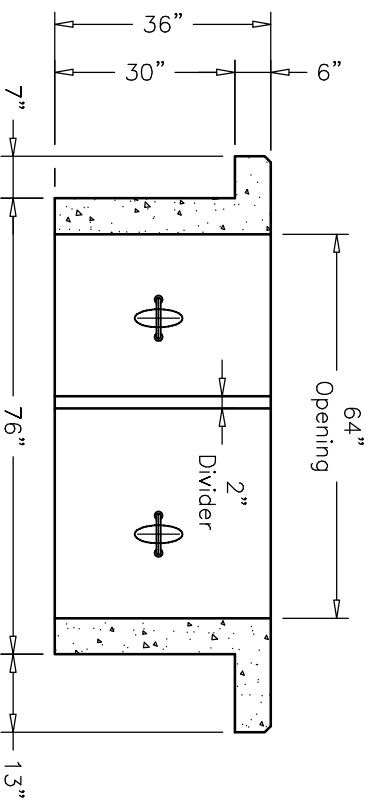

BOX = Wt: 3,000 Lbs. (0.74 CY Conc.)
PAD = Wt: 4,200 Lbs. (1.04 CY Conc.)
DIVIDER = Wt: 110 Lbs. (0.03 CY Conc.)
<b>TOTAL = Wt: 7,310 Lbs.</b>

**NOTES:**

- Concrete: 28 Day Compressive Strength  $f_c = 5,000$  psi.
- Reinforcing: ASTM A-615, Grade 60.
- Pad Designed for Pad Mounted Transformer per Cooper Power Systems Drawing Dated 07/09/2013 Ref: P3DV03R02M07.
- Slab Shall be Supported by a 3" Min. Layer of Level Compacted Crushed Stone or Sand Bed.

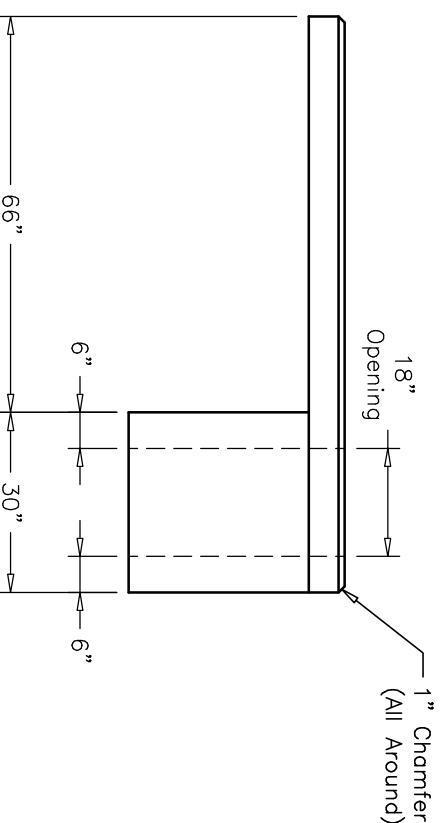

DRAWN	DATE
L. Paul	05/27/11
CHECKED	DATE
APPROVED	DATE
REVISION	DATE
REVISION	DATE

Three Phase 500 kva - 2500 kva  
8'x8' Pit Box Pad w/ Divider

DRAWING NAME	XXXXXX
FILE LOC.	Std Pads/Duke
SHEET	1 OF 1
SALES ORDER NO.	XXXXX
SCALE:	3/8"=1'-0"