

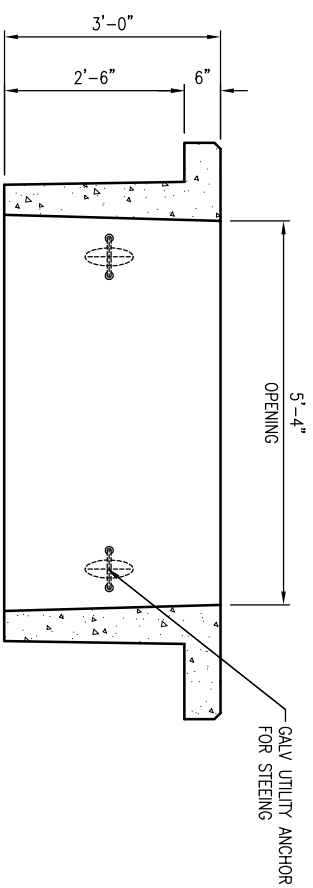


PLAN VIEW
BOX WALLS POINT DOWN
SCALE: 3/8" = 1'-0"

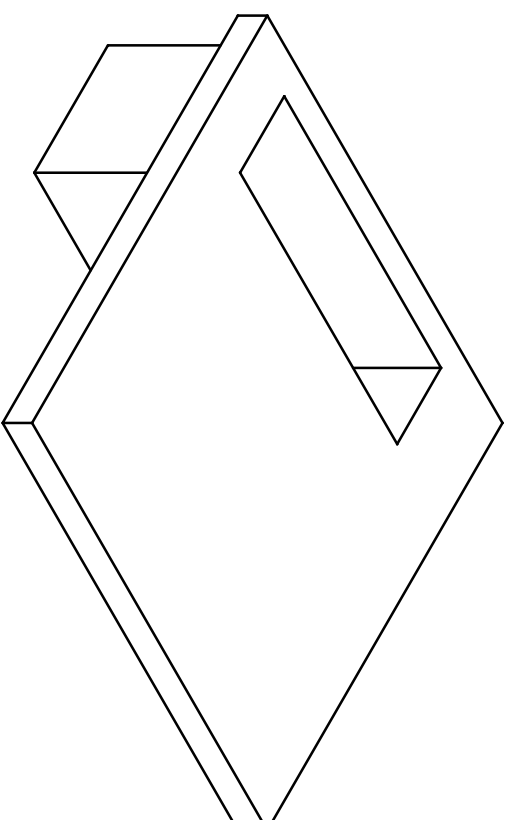

SECTION A-A
SCALE: 3/8" = 1'-0"

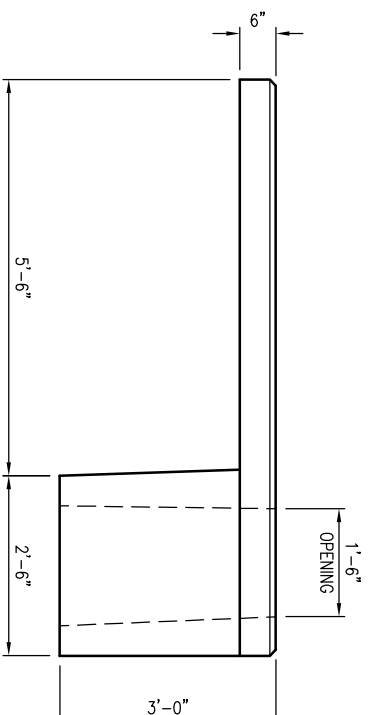

VIEW B
SCALE: 3/8" = 1'-0"

- DESIGN NOTES:**
1. THE CONCRETE SHALL BE 5,000 PSI (MIN) AT 28 DAYS COMPRESSIVE STRENGTH.
 2. PAD DESIGNED FOR PAD MOUNTED TRANSFORMER PER COOPER POWER SYSTEMS DRAWING DATED 07/09/2013 REF: P3DV03R02M07.
 3. STEEL REINFORCEMENT: REBAR ASTM A-615 GRADE 60.
 4. SLAB SHALL BE SUPPORTED BY A 3" MIN. LAYER OF LEVEL COMPACTED CRUSHED STONE OR SAND BED.

THIS MUST BE FILLED OUT BEFORE MANUFACTURING BEGINS

APPROVED W/ NO EXCEPTIONS TAKEN:

APPROVED AS NOTED:

REVISED AND RESUBMIT:

SIGNATURE _____ DATE _____

WEIGHTS		
SECTION	WEIGHT (lb)	COMPLETION
PT PAD	7,200	1,78



THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS LOANED TO YOU FOR YOUR USE ONLY. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT © 2017 OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED.

96" X 96" PT BOX PAD

SUBMITTAL
THREE PHASE 500 kva - 2500 kva

DATE	SUES	DRAWN	ENGINEER	CHECKED	SALES ORDER
08/17	LMP				
9696-PT Box-2017					



REVISION	DATE	BY	SHEET	DESCRIPTION OF REVISION	REQUESTED BY
A					
B					

REVISIONS

DESCRIPTION OF REVISION

REQUESTED BY