H20-2,500 gal.

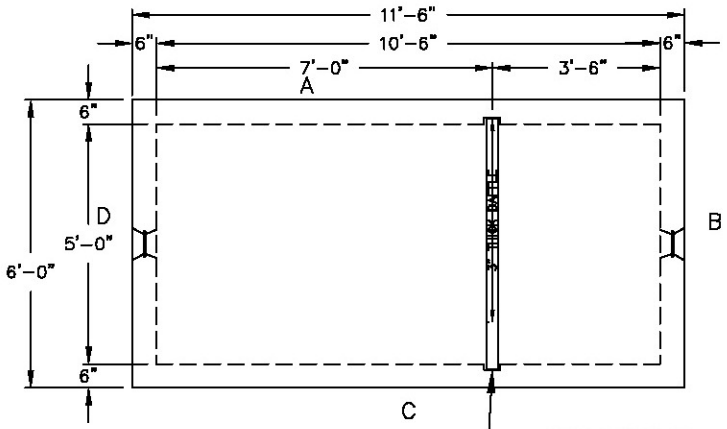

PLAN VIEW

4"W X 1"D BAFFLE SLOT IN BASESLAB AND WALLS

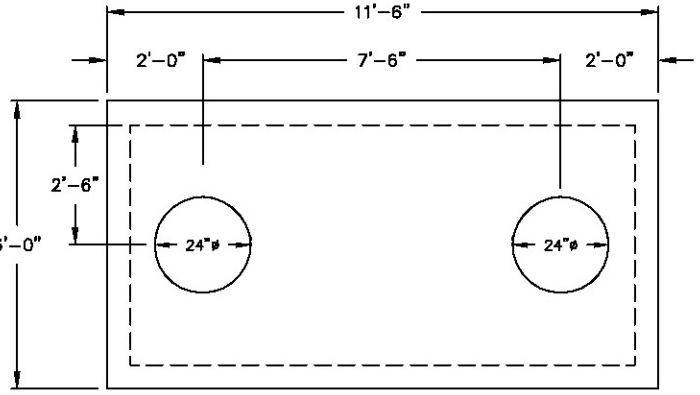

MONO - TOP DETAIL

NOTES:
1. CONCRETE: 28 DAY COMP. STRENGTH F'C = 4,000 PSI.

2. PRECAST STRUCTURES ARE PRODUCED TO MEET OR EXCEED ASTM SPECIFICATIONS.

3. SUPPORTS AN H20 LOADING AS INDICATED BY AASHTO.

4. CONTRACTOR TO VERIFY SIZE AND LOCATION OF ALL OPENINGS.

5. ALL INTERNAL PIPING DONE BY OTHERS – NOT OLD CASTLE

6. STATE APPROVAL
#48-106-16D-C4
(F.A.C.) 64C-6.013
FLORIDA ADMINISTRATION CODE
(F-BC) SECTION 1003.4 THRU
SECTION 1003.4.2.2 AND
FLORIDA ADMINISTRATION CODE

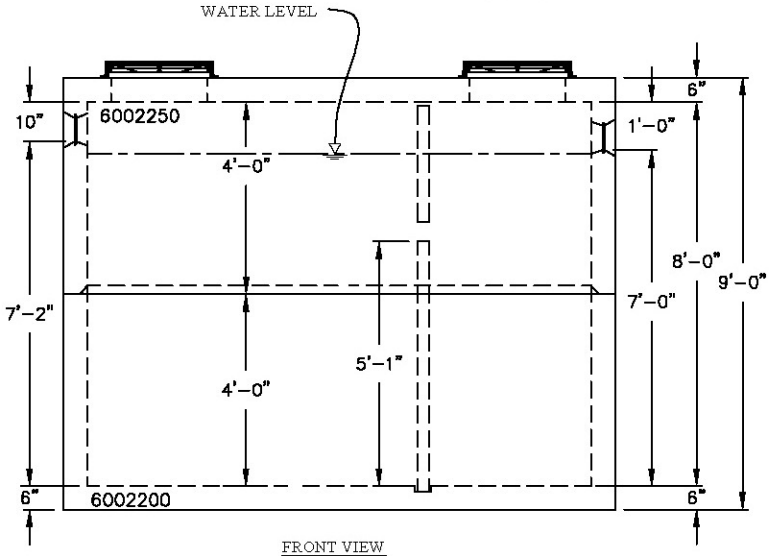

FRONT VIEW

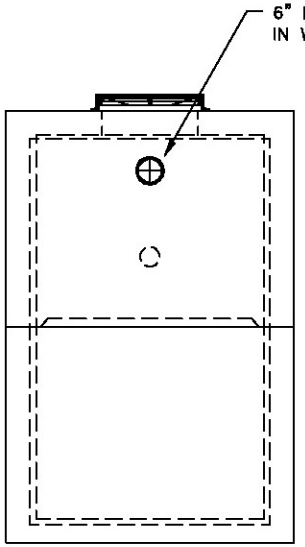

SIDE VIEW

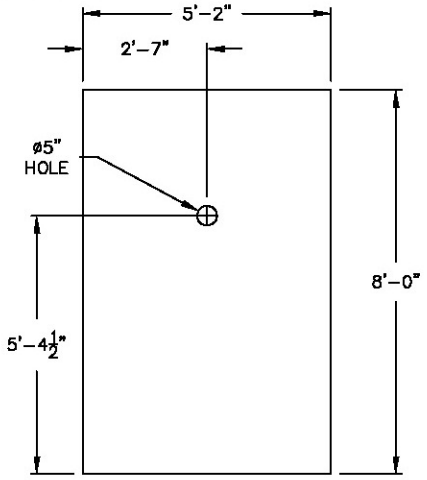

6002300
3" THICK BAFFLE DETAIL

PROPERTY OF OLDCASTILE PRECAST, NOT TO BE REPRODUCED WITHOUT WRITTEN CONSENT.2005

WALLS	PIPE SIZE	PIPE INVERT	HOLE SIZE	HOLE UP	PRODUCTION YARDAGE		WEIGHTS	REINFORCEMENT
B	--	+3.50	6" RUBBER BOOT	3'-6"	BASE:			
D	--	+3.66	6" RUBBER BOOT	3'-8"	WALL:			
					TOP:			
BAFFLE	--	+2.58	5"ø	2'-7"	BAFFLE:			
REMARKS:					CASTING:			
					STEEL WT.:		CONC WT.:	

STRUCTURE TYPE – 2500 GALLON GREASE TRAP – 60"X126"X96" (H20 RATED)

Oldcastle™ Precast Inc.
690 WEST TAFT-VINELAND RD. ORLANDO FL 32824
(407) 855-7580 • FAX: (407) 855-2424

CONTRACTOR

PROJECT

DRAWN: SJW		DATE: 02/28/07	
CHECKED:		DATE:	
PRODUCED:		SHIPPED:	
STR. NO.: 2000gal	S.O. NO.: 00000		LN. NO.:
DRAWING NO.:			LOC.:
SCALE: 1"=4'	SHEET: 1 OF 1		