

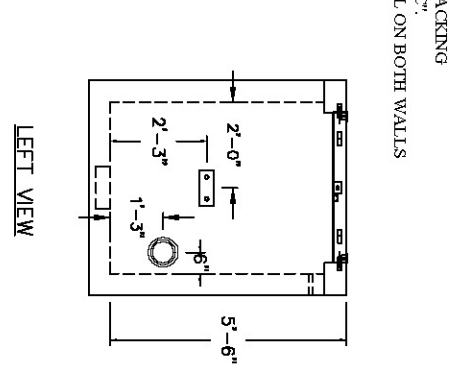
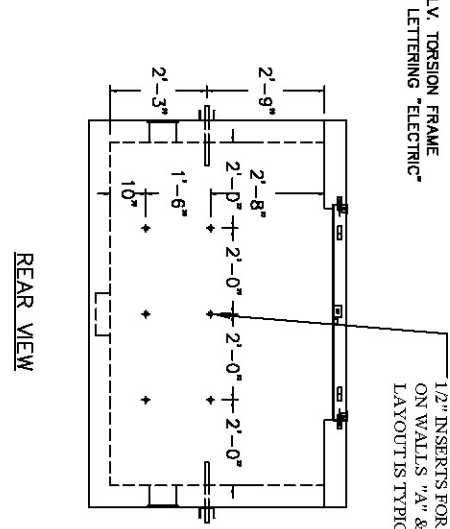
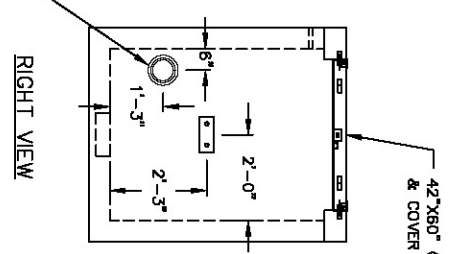


EXTRA #6 BARS AROUND OPENINGS

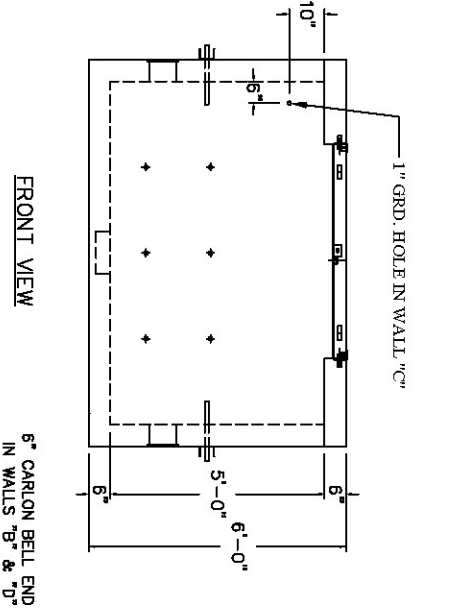

- NOTES:
1. CONCRETE: 28 DAY COMP. STRENGTH F'C = 4,000 PSI.
 2. PRECAST STRUCTURES ARE PRODUCED TO MEET OR EXCEED ASTM SPECIFICATIONS.
 3. SUPPORTS AN H20 LOADING AS INDICATED BY AASHTO.
 4. CONTRACTOR TO VERIFY SIZE AND LOCATION OF ALL OPENINGS.

STRUCTURE TYPE "48"X96"X60" TECO ELECTRICAL PULL BOX"



890 WEST TAFT VINELAND RD. ORLANDO FL 32824
(407) 856-7580 • FAX: (407) 856-2424

PROJECT	TRCO	LOC.	REMARKS:	BASE:	PRODUCTION YARDAGE	WEIGHTS	REINFORCEMENT
DRAWING NO.	SCALE: 1"=6'	SHEET: 1 OF 1	DRAMA: S/W	WALL:			
STR. NO.: XX	S.O. NO.: 00000	LN. NO.:	CHECKED:	TOP:			
DRAWING NO.	SCALE: 1"=6'	SHEET: 1 OF 1	PRODUCED:	WALL:			
			SHIPPED:	LID:			
			DATE: 2/9/07	CASTING:	01700B0	---	4260 TORSION FRAME AND COVER
			DATE:	HATCH:			
			DATE:	STEEL WT.:			