

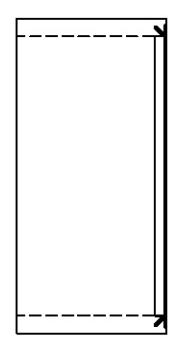



- NOTES:**
1. CONCRETE: 28 DAY COMP. STRENGTH F'C = 4,000 PSI.
 2. PRECAST STRUCTURES ARE PRODUCED TO MEET OR EXCEED ASTM SPECIFICATIONS.
 3. SUPPORTS AN H20 LOADING AS INDICATED BY AASHTO.
 4. CONTRACTOR TO VERIFY SIZE AND LOCATION OF ALL OPENINGS.
 5. VERIFY IF ANY LETTERING IS REQUIRED ON COVER

KNOCK-OUTS, BLOCK-OUTS, TERMINATORS, AND CUSTOM LETTERING ON COVERS ARE AVAILABLE UPON REQUEST. CONTRACTOR MUST SPECIFY

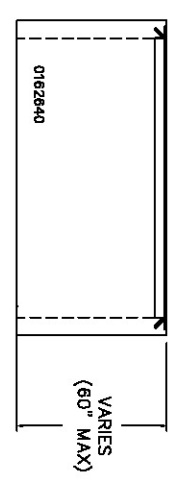

FRONT VIEW

RIGHT VIEW

REAR VIEW

LEFT VIEW

STRUCTURE TYPE "48"x78"xVAULT" PULL BOX"



Oldcastle™ Precast Inc.

890 WEST TAFT VINELAND RD. ORLANDO FL 32824
 (407) 856-7580 • FAX: (407) 856-2424

PRO-TECH
 FBCCF CHILDREN'S BUILDING

DRAWN: SUE	DATE: 2/27/08
CHECKED:	DATE:
PRODUCED:	SHIPPED:
STR. NO.: 1	S.O. NO.: 56344
DRAWING NO.:	LN. NO.:
SCALE: 1"=6'	SHEET: 1 OF 1

WALLS	BASE:	PRODUCTION YARDAGE	WEIGHTS	REINFORCEMENT
	WALL:			
	WALL:			
	WALL:			
	LID:			
	CASTING:			
	HATCH:	4088600	---	48X78 3PCS GALV FAC
	STEEL WT.:			