


NOTES:

1. INLET & OUTLET ARE IDENTIFIED.
2. TANK IS MARKED 1,500 GALLON.
3. INLET & OUTLET BAFFLES WILL ACCEPT A NOM. 4" SCH. 40 PVC PIPE.
4. 1 1/2" x 3'-6" STRIPS OF RAM-NEK USED FOR SEALING JOINTS.
5. OPENINGS MAY BE SIZED & LOCATED AS SPECIFIED WITHIN STRUCTURAL LIMITATIONS.
6. BAFFLES ARE TO BE INSTALLED BY OTHERS.
7. METRIC EQUIVALENTS (SHOWN IN PARENTHESIS) ARE ROUNDED TO NEAREST 5mm, 5kg OR 5L.
8. PLACE OLDCASTLE LOGO ON OUTSIDE OF TANK.
9. .8T CABLE LOOP, PLACED IN ACCESS LIDS FOR LIFTING
10. DESIGNED FOR 3'-0" MAX BURY.



Oldcastle Precast[®]
 2240 S. Yellowstone Hwy, Idaho Falls, Idaho 83402
 Phone: 208-522-6150 Fax: 208-522-9701

Grease Trap



FILE NAME: 230TBGI03

ISSUE DATE: 1/2011

www.oldcastleprecast.com

**1500 Gal Low Profile
 (Non Traffic Rated)
 ISO View**

Copyright © 2011

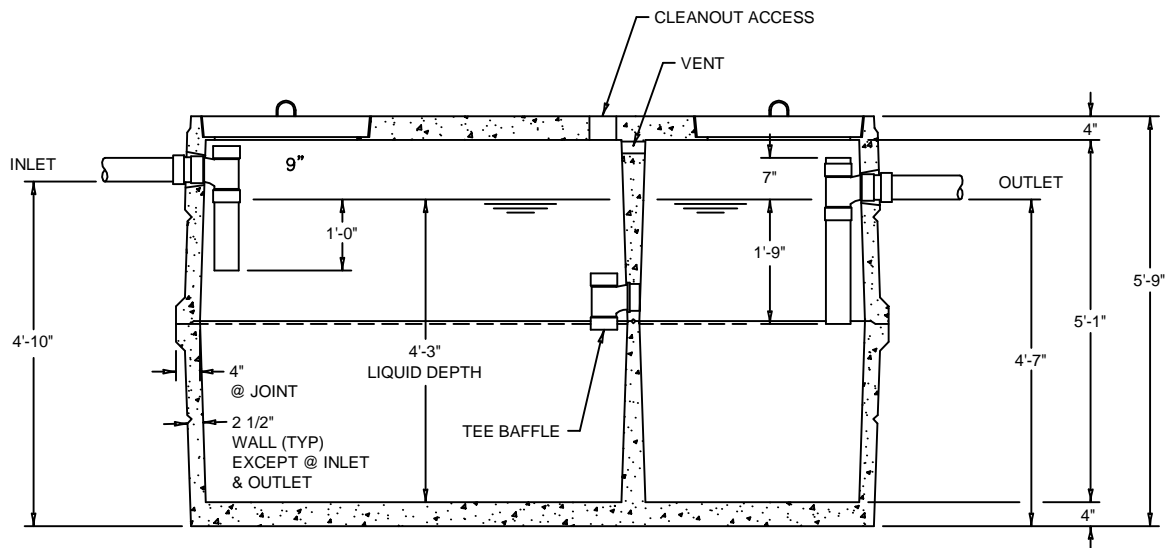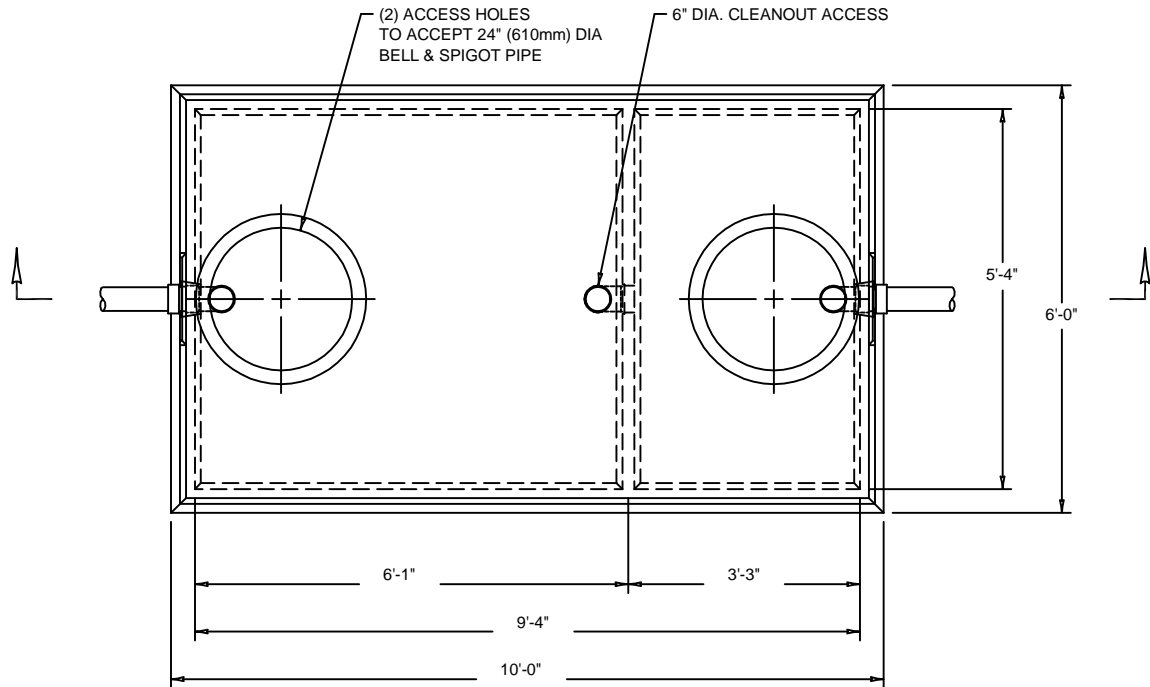

2240 S. Yellowstone Hwy, Idaho Falls, Idaho 83402
 Phone: 208-522-6150 Fax: 208-522-9701

Grease Trap

FILE NAME: 230TBG103

ISSUE DATE: 1/2011

www.oldcastleprecast.com

**1500 Gal Low Profile
 (Non Traffic Rated)**

Copyright © 2011