

- 3. INLET & OUTLET BAFFLES WILL ACCEPT A NOM. 4" SCH. 40 PVC PIPE.
- 4. IT IS RECOMMENDED THAT BITUMINOUS MASTIC BE USED AT JOINT.
- OPENINGS MAY BE SIZED & LOCATED AS SPECIFIED WITHIN STRUCTURAL LIMITATIONS.
- 6. BAFFLES ARE TO BE INSTALLED BY OTHERS.
- 7. DESIGNED FOR 3'-0" MAX. BURY.




Septic Tank

FILE NAME: 230TBST04 ISSUE DATE: 1/2011 1500 Gal Low Profile (Non Traffic Rated) ISO View

Phone: 208-522-6150 Fax: 208-522-9701

www.oldcastleprecast.com

Copyright © 2011

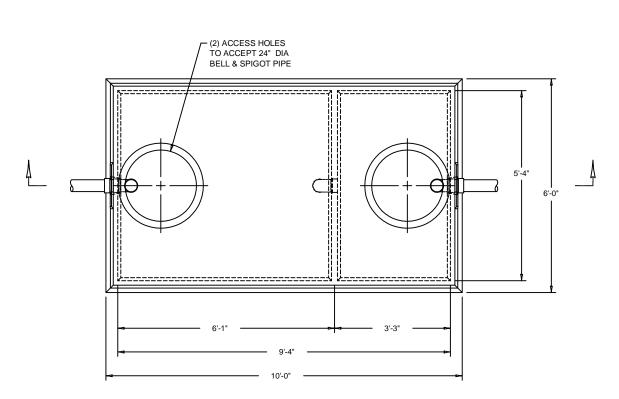

PLAN VIEW

