


Nassau County
Catch Basin

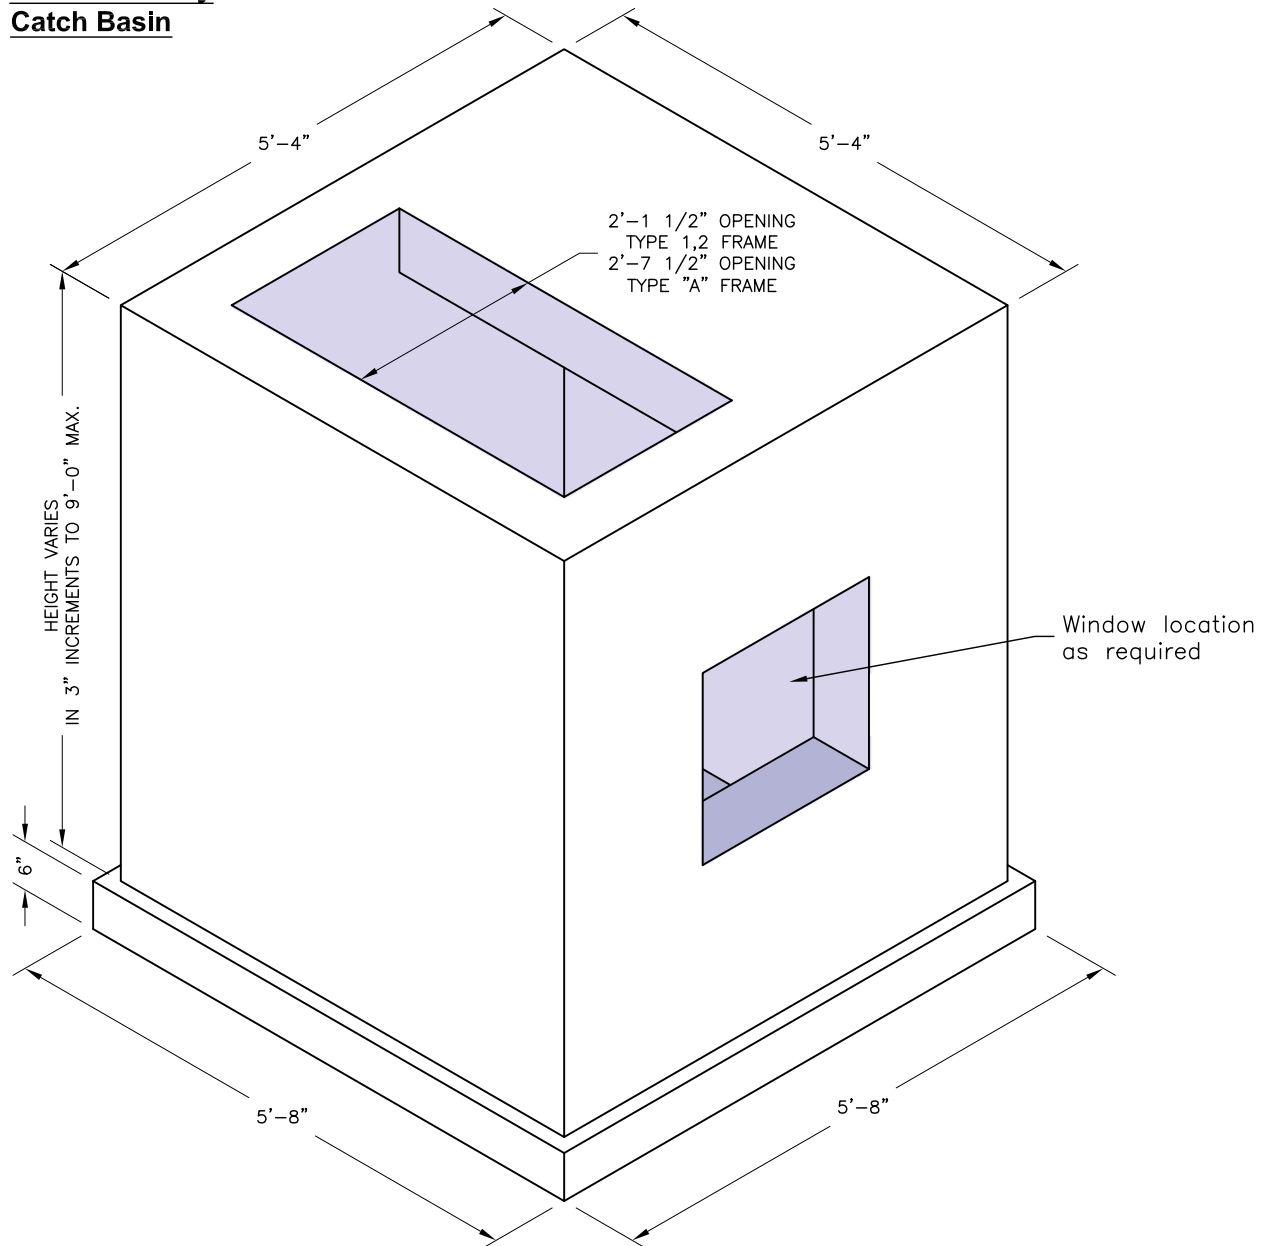

SPECIFICATIONS:

1. Concrete: 28 Day Compressive Strength $f'_c = 4,000$ psi.
2. Steel reinforcement: ASTM A-615, Grade 60, ASTM A-185.
3. Internal dimensions of the opening in the slab shall equal the internal dimensions between the flanges of the casting used.
4. All pipe openings to be cast at time of manufacturing.