


NOTE : Fill in Desired Dimensions on the Back of This Sheet
and Fax to Your Oldcastle Sales Representative for a
Quote and Estimated Delivery.



Sub-Grade to be Graded Evenly
to Ensure Uniform Bearing

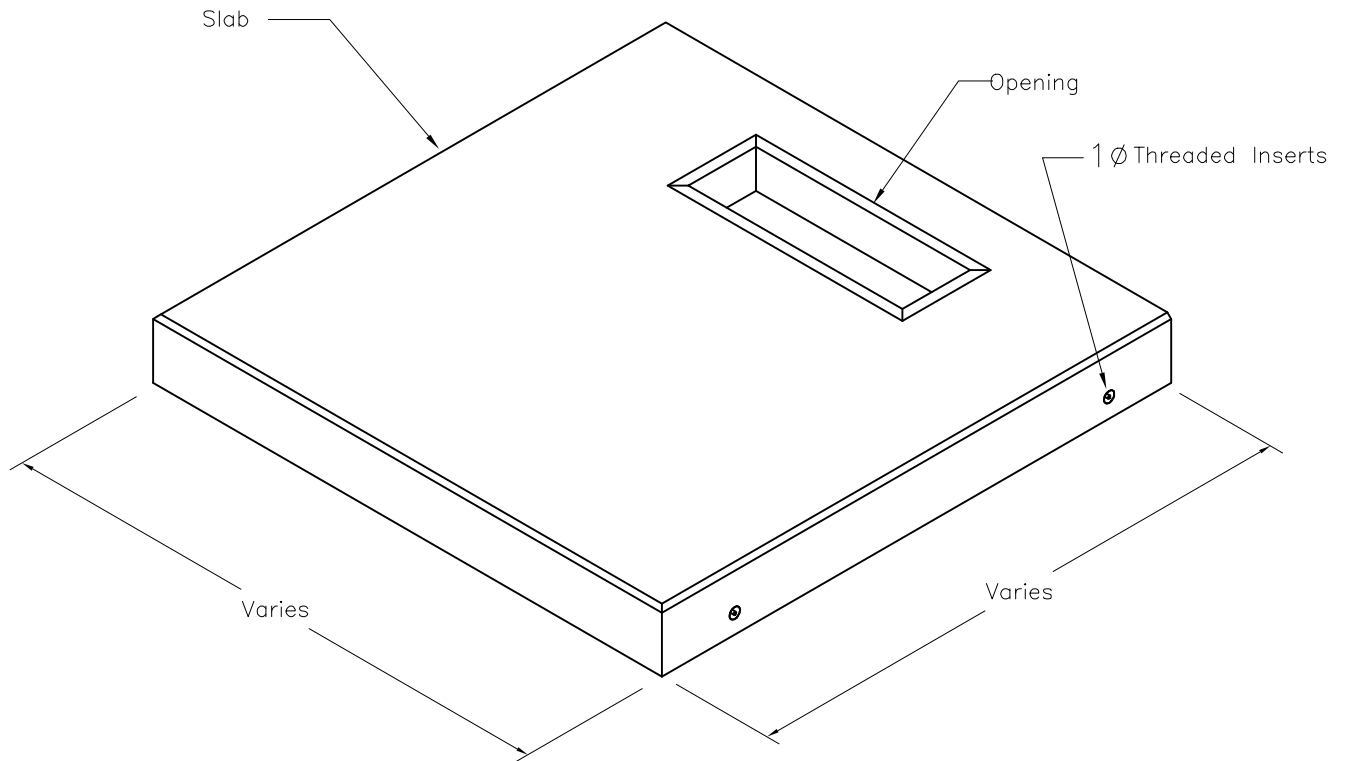

Oldcastle Precast[®]

CUSTOM

FILE NAME: 324UETTPCUSTOM_DET.DWG

ISSUE DATE: January, 2008


www.oldcastleprecast.com

**Various Sizes
Custom Transformer Pad
Order Form**


Copyright © 2008 **Oldcastle Precast**[®]

GENERAL NOTES:

1. Concrete: 28 Day Compressive Strength $f'_c = 5,000$ psi
2. Steel Reinforcement: ASTM A-615, Grade 60
3. Cover to Steel-1" Minimum

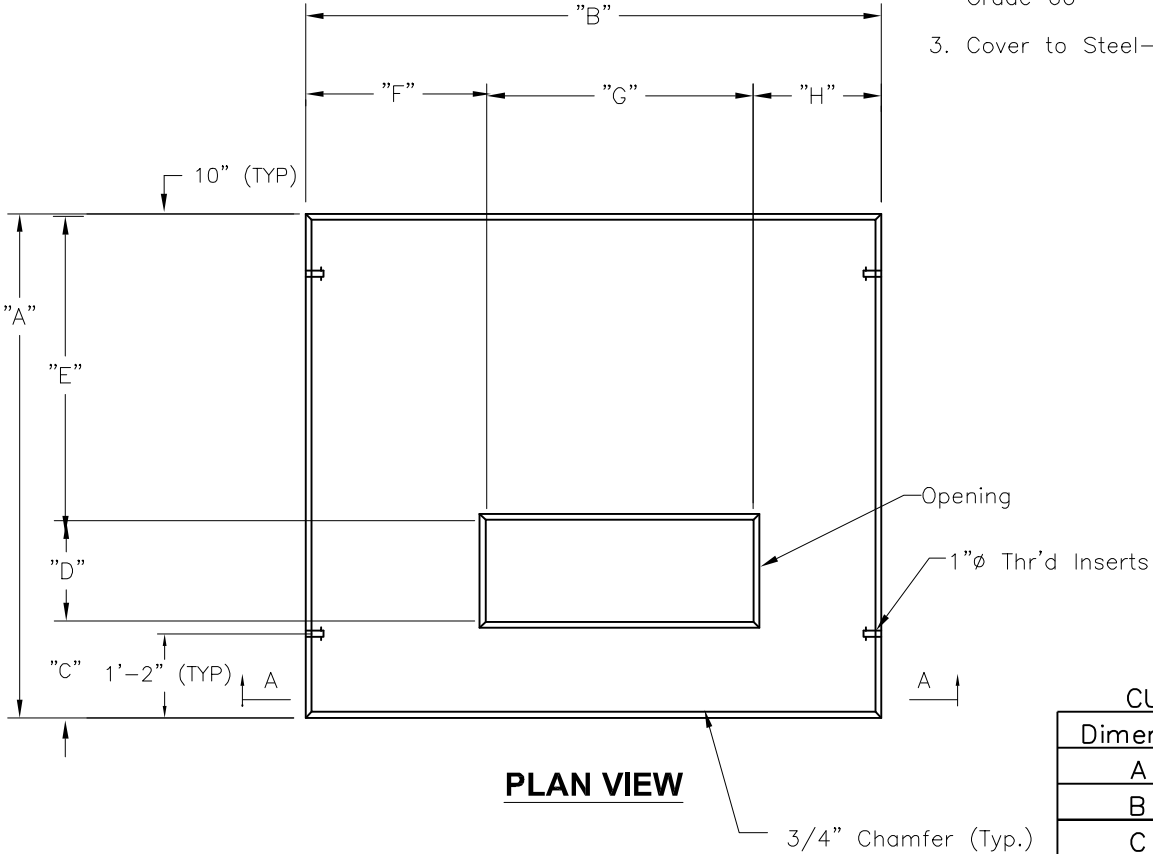

CUSTOM PAD	
Dimensions	0'-0"
A	
B	
C	
D	
E	
F	
G	
H	
Thickness	

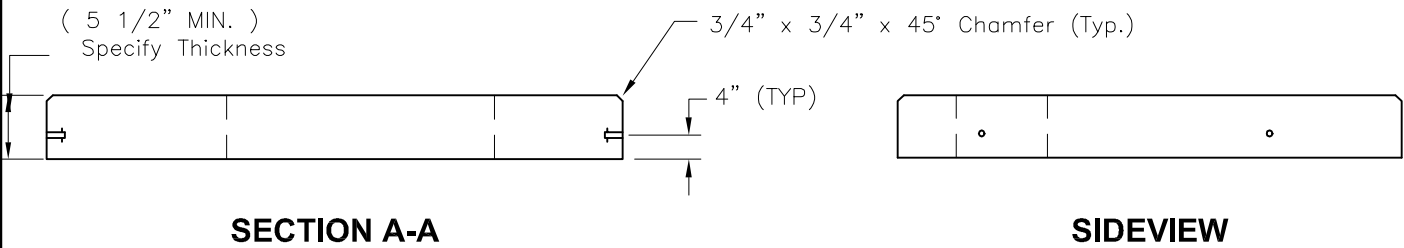

Oldcastle Precast[®]

CUSTOM

FILE NAME: 324UETTPCUSTOM_DET.DWG

ISSUE DATE: January, 2008

www.oldcastleprecast.com

**Various Sizes
Custom Transformer Pad
Order Form**

Copyright © 2008 **Oldcastle Precast**[®]