

GENERAL NOTES:

THE STORMCAPTURE SYSTEM BY OLDCASTLE STORMWATER SOLUTIONS IS PART OF THE STORMWATER MANAGEMENT SYSTEM FOR THE RESPECTIVE SITE, AS PREPARED BY THE PROJECT DESIGN ENGINEER. IT IS THE RESPONSIBILITY OF THE DESIGN ENGINEER TO DETERMINE DESIGN FLOW RATES, PRE-TREATMENT AND POST-TREATMENT REQUIREMENTS, STORAGE VOLUME, AND ENSURE THE FINAL DESIGN MEETS ALL CONVEYANCE AND STORAGE REQUIREMENTS. SYSTEM DESIGN AND TYPE, SOIL ANALYSIS, LOADING REQUIREMENTS, COVER HEIGHT AND MODULE SIZE DETERMINE THE FOUNDATION TYPE AND REQUIREMENTS AS STATED HEREIN. ANY VARIATIONS FOUND DURING CONSTRUCTION FROM THE SITE AND SYSTEM ANALYSIS MUST BE REPORTED TO THE PROJECT DESIGN ENGINEER. THE PROJECT DESIGN ENGINEER IS RESPONSIBLE FOR OBTAINING A GEOTECHNICAL ENGINEERING REPORT VERIFYING THE BEARING CAPACITY STATED IN DESIGN NOTES.

DESIGN NOTES:

1. DESIGN LOADINGS:

A. AASHTO HS20-44 W/ IMPACT.

B. DEPTH OF COVER = 6" TO 4'-0".

C. ASSUMED WATER TABLE = BELOW BOTTOM.

D. EQUIVALENT FLUID PRESSURE = 45 PCF.

E. LATERAL LIVE LOAD SURCHARGE = 80 PSF.

F. NO LATERAL SURCHARGE FROM ADJACENT STRUCTURES.

2. CONCRETE 28 DAY COMPRESSIVE STRENGTH SHALL BE 6,000 PSI.

3. STEEL REINFORCEMENT: REBAR, ASTM A-615, GRADE 60.

4. CEMENT: ASTM C-150 SPECIFICATION.

5. STORMCAPTURE MODULE TYPE = DETENTION.

6. REQUIRED BASE LAYER DEPTH = 2" SAND BEDDING LAYER.

7. REQUIRED NATIVE ALLOWABLE SOIL BEARING PRESSURE = 2,500 PSF.

8. REFERENCE STANDARDS:

A. ASTM C 890

B. ASTM C 891

C. ASTM C 913

9. LESS THAN 6" OR GREATER THAN 4'-0" OF COVER REQUIRES CUSTOM STRUCTURAL DESIGN AND MAY REQUIRE THICKER SUBGRADE.
- INSTALLATION NOTES:
- STORMCAPTURE MODULES ARE TO BE INSTALLED IN ACCORDANCE WITH ASTM C891, INSTALLATION OF UNDERGROUND PRECAST UTILITY STRUCTURES. PROJECT PLAN AND SPECIFICATIONS MUST BE FOLLOWED ALONG WITH ANY APPLICABLE REGULATIONS.

1. PLAN LINE, GRADE AND ELEVATIONS MUST BE FOLLOWED.

2. WHERE SPECIFIED, AN 8 OZ. NON-WOVEN GEOTEXTILE FABRIC MUST BE USED AS A SEPARATION LAYER AROUND THE STORMCAPTURE SYSTEM.

3. PENETRATIONS IN THE GEOTEXTILE MAY ONLY BE MADE WITH SMOOTH WALL PIPES. MAKE PENETRATIONS FOR ALL OUTLETS BEFORE MAKING PENETRATIONS FOR ANY INLETS.


4. SUBGRADE MATERIALS, IF SPECIFIED, SHALL BE CLEAN, DURABLE CRUSHED AGGREGATE COMPACTED AS DIRECTED BY THE ENGINEER. OLDCASTLE RECOMMENDS SIZE 5, 56, OR 57 (PER ASTM C33).

5. DESIGNATED EMBEDDED LIFTERS MUST BE USED. USE PROPER RIGGING TO ASSURE ALL LIFTERS ARE EQUALLY ENGAGED WITH A MINIMUM 60 DEGREE ANGLE ON SLINGS AS NOTED AND IN ACCORDANCE WITH OLDCASTLE LIFTING PROCEDURES.

6. MODULES MUST BE PLACED AS CLOSE TOGETHER AS POSSIBLE, AND GAPS SHALL NOT BE GREATER THAN 3/4". ALL EXTERIOR SYSTEM JOINTS SHALL BE COVERED WITH A MIN. 8" JOINT WRAP ON SIDES AND TOP (CS-212 CONSEAL OR EQUIVALENT). IN A CLAMSHELL DESIGN INSTALL ONE ROW CS-102 CONSEAL (OR EQUIVALENT) BETWEEN PRECAST PIECES.


7. AUTHORIZATION SHALL BE GIVEN BY THE PROJECT ENGINEER OR DESIGNATED PERSON PRIOR TO PLACEMENT ON BACKFILL FOR THE SYSTEM. CARE MUST BE TAKEN DURING PLACEMENT OF BACKFILL NOT TO DISPLACE MODULES OR JOINT WRAP. BACKFILL SHALL BE COMPACTED TO 95% STANDARD PROCTOR DENSITY OR AS SPECIFIED, AND SHALL NOT BE COMPACTED WITHIN 6" OF MODULE.

8. CONSTRUCTION EQUIPMENT EXCEEDING DESIGN LOADING SHALL NOT BE ALLOWED ON STRUCTURE.

9. TERMADUCTS TO BE KNOCKED OUT AT SPECIFIED LOCATIONS IN FIELD BY OTHERS. SEE SITE LAYOUT FOR LOCATIONS.
- INLETS AND RISERS:
- ALL PIPE INLETS SHALL EXTEND INSIDE MODULE A MINIMUM OF 4". PLACE A NON-SHRINK, NON-METALIC GROUT, MIN. 3,000 PSI IN ANNULAR SPACE TO ELIMINATE ALL VOIDS.
- STORMCAPTURE®
- TABLE OF CONTENTS
- |                     |   |
|---------------------|---|
| NOTES & GENERAL ISO | 1 |
| TYPICAL ELEVATION   | 2 |
| EXTERIOR DETAILS    | 3 |
| INTERIOR DETAILS    | 4 |
- NOTE: THIS VIEW IS FOR ILLUSTRATION PURPOSES ONLY TO SHOW FEATURES OF THE SYSTEM. ACTUAL LAYOUT VARIES BY PROJECT, SEE SITE PLAN LAYOUT. ALL PERIMETER WALLS ARE SOLID.
- A detailed isometric drawing of a Stormcapture module. The module is a rectangular box with a flat top and vertical sides. The top surface is labeled 'SURFACE/GRADE' and features a grid of small arrows pointing upwards. A circular 'MANWAY ACCESS (WHERE REQUIRED)' is shown on the top surface. The sides of the module are labeled 'STORM CAPTURE MODULES BY OLDCASTLE PRECAST INC.' and show vertical joints. The bottom of the module is labeled 'BOTTOM MODULE' and shows a grid of small circles representing 'STANDARD BLOCKOUTS'. A circular '4" DIAM. TERMADUCT FOR HYDRAULIC PASSAGE' is shown on the side. The module is surrounded by 'BACKFILL MATERIAL'.
- TYPICAL ISO VIEW  
N.T.S.
- \*THIS MUST BE FILLED OUT BEFORE MANUFACTURING BEGINS\*
- APPROVED W/ NO EXCEPTIONS TAKEN: ☐  
APPROVED AS NOTED: ☐  
REVISE AND RESUBMIT: ☐
- PRELIMINARY -  
NOT FOR CONSTRUCTION
- SIGNATURE \_\_\_\_\_ DATE \_\_\_\_\_
- 

**Oldcastle®**  
Stormwater Solutions

7821 SOUTHPARK PLAZA, SUITE 200, LITTLETON, CO 80120  
PHONE: 1-888-965-3227 FAX: 303-794-7497
- THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT ©2018 OLDCASTLE PRECAST, INC ALL RIGHTS RESERVED
- STORMCAPTURE  
GENERAL ISO
- CUSTOMER
- |   |           |           |             |                      |                 |
|---|-----------|-----------|-------------|----------------------|-----------------|
| DATE                                    | SALES STS | DRAWN STS | ENGINEER JH | CHECKED              | SALES ORDER     |
| DRAWING NUMBER<br>SC2 - 13 ft clamshell |           |           |             | REVISION<br>REV DATE | SHEET<br>1 OF 4 |

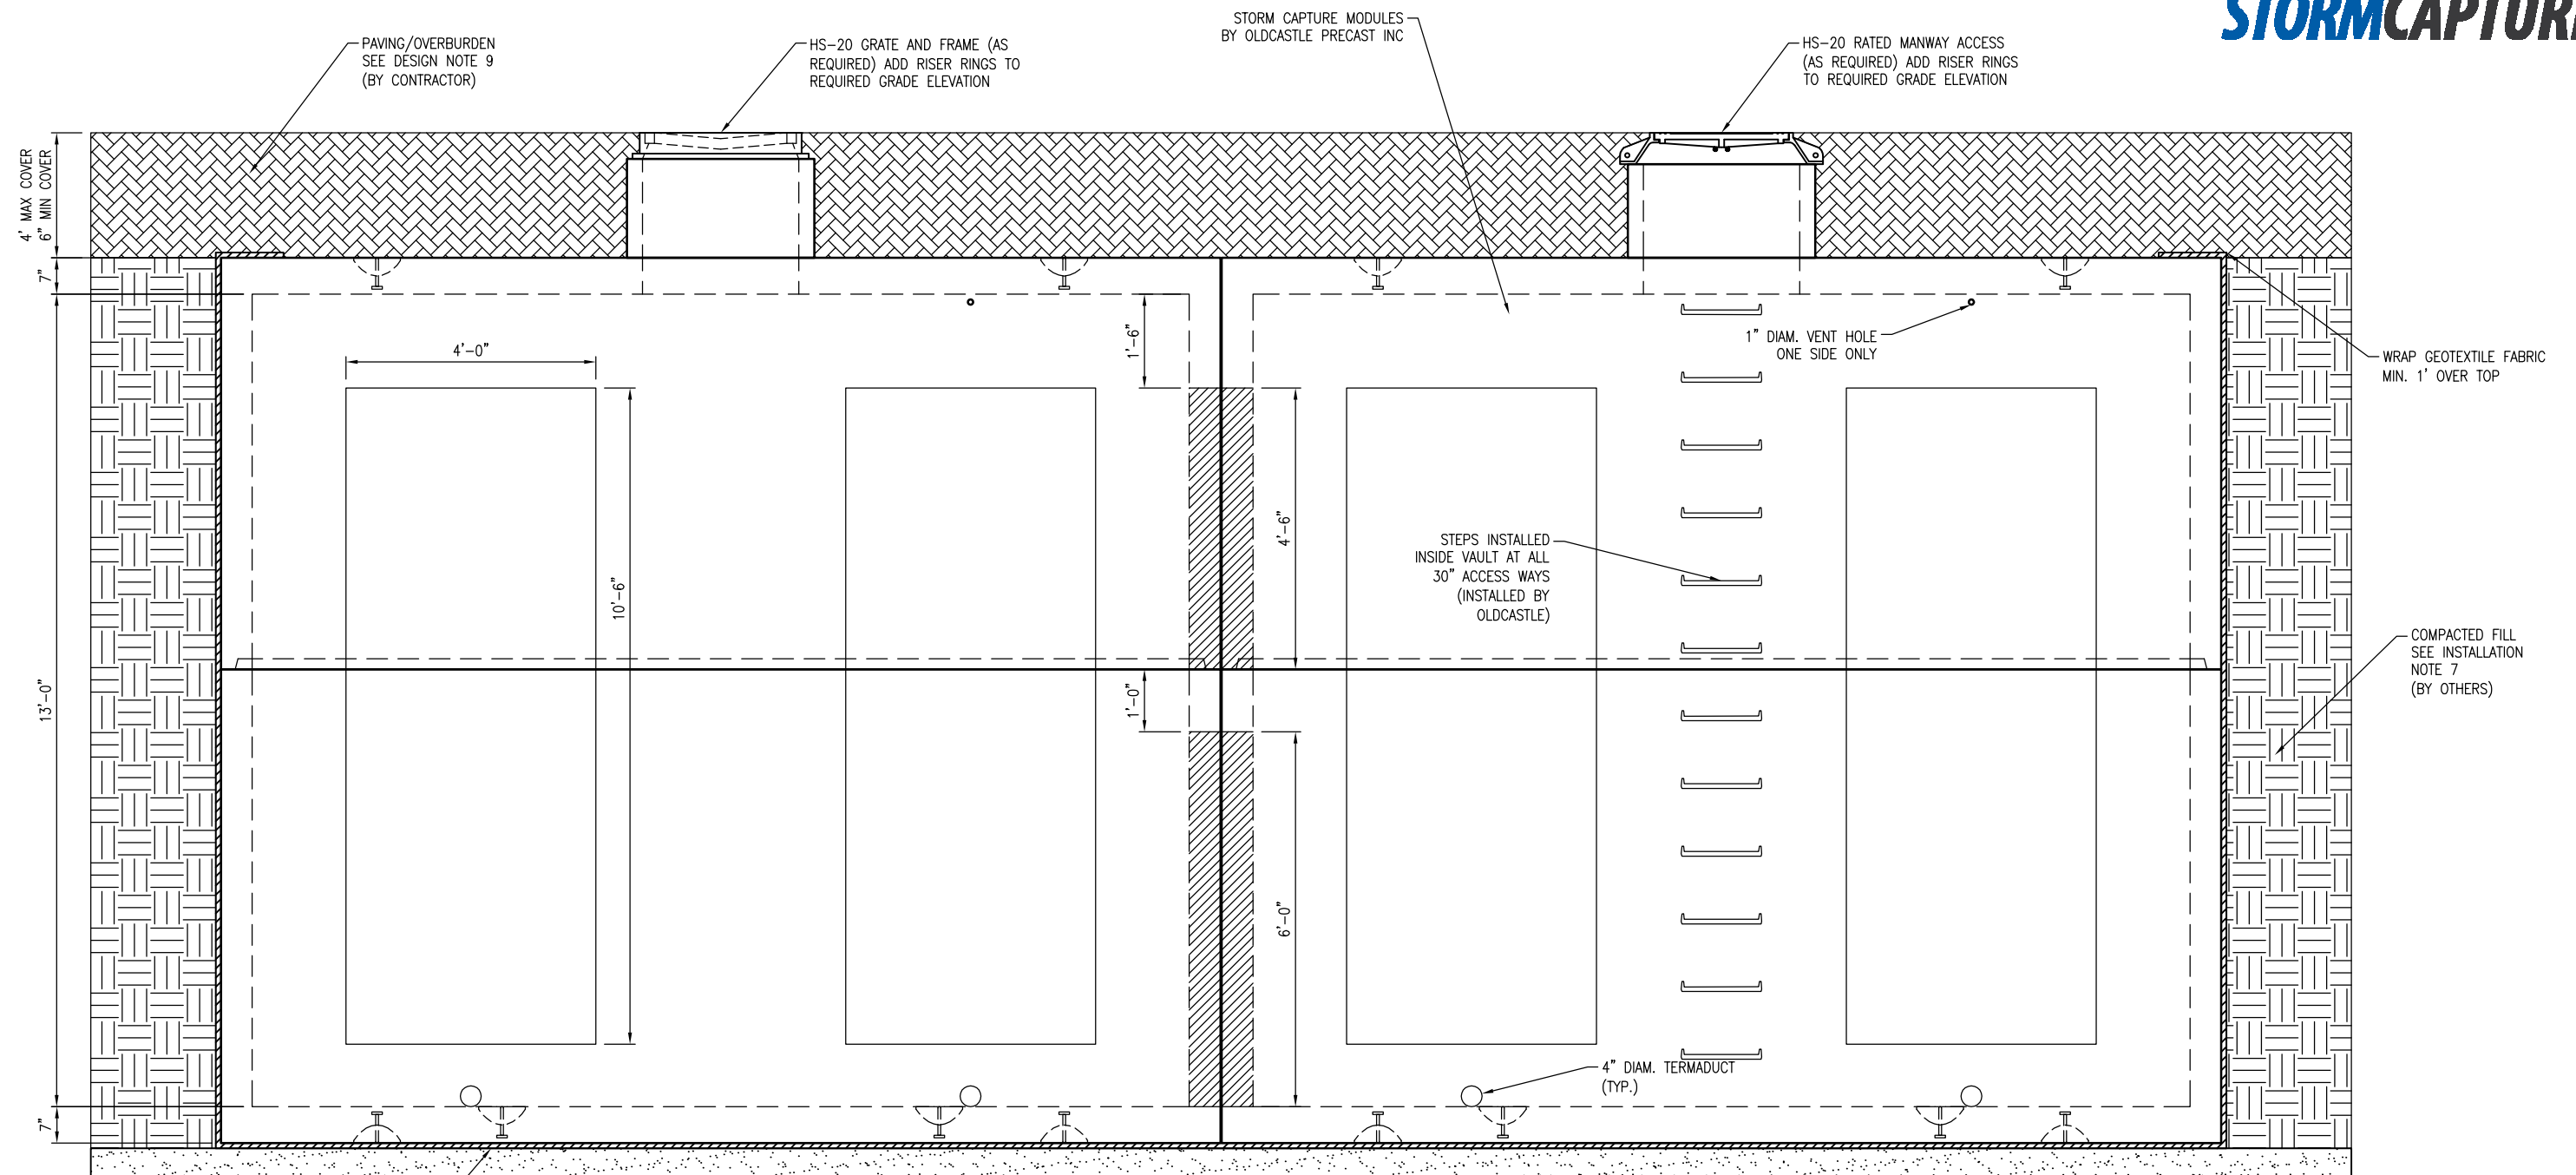

- PRELIMINARY -  
NOT FOR CONSTRUCTION




THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT ©2018 OLDCASTLE PRECAST, INC ALL RIGHTS RESERVED


**STORMCAPTURE**  
TYPICAL ELEVATION

	CUSTOMER
--	----------


DATE	SALES STS	DRAWN STS	ENGINEER JH	CHECKED	SALES ORDER
DRAWING NUMBER SC2 - 13 ft clamshell				REVISION REV DATE	SHEET 2 OF 4

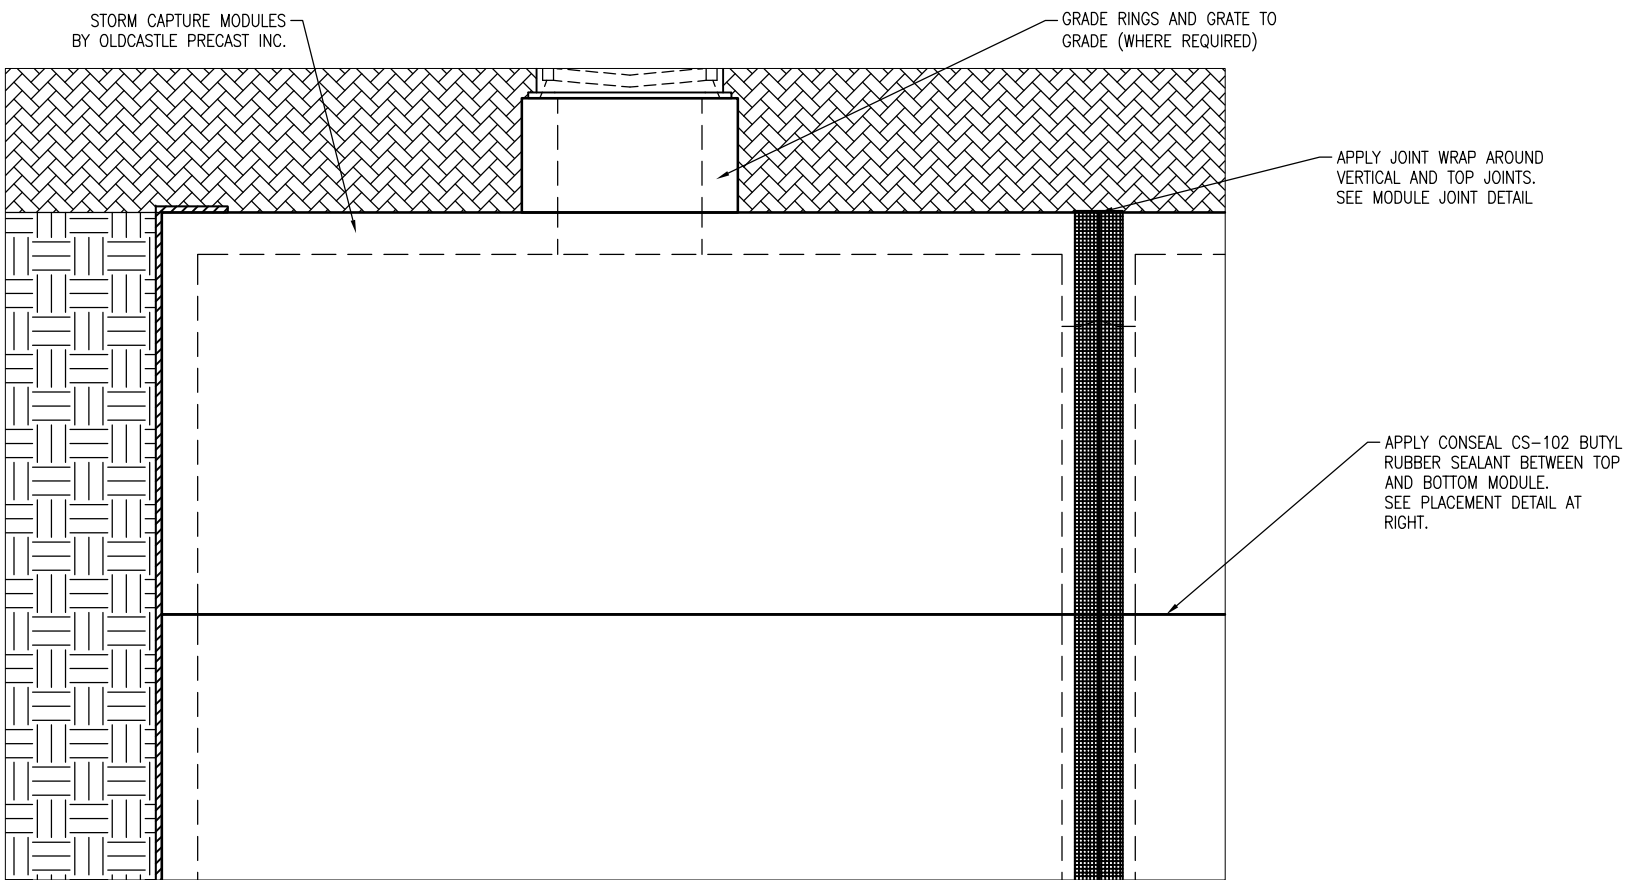


GRADED INLET DETAIL  
SCALE: 3/8" = 1'-0"

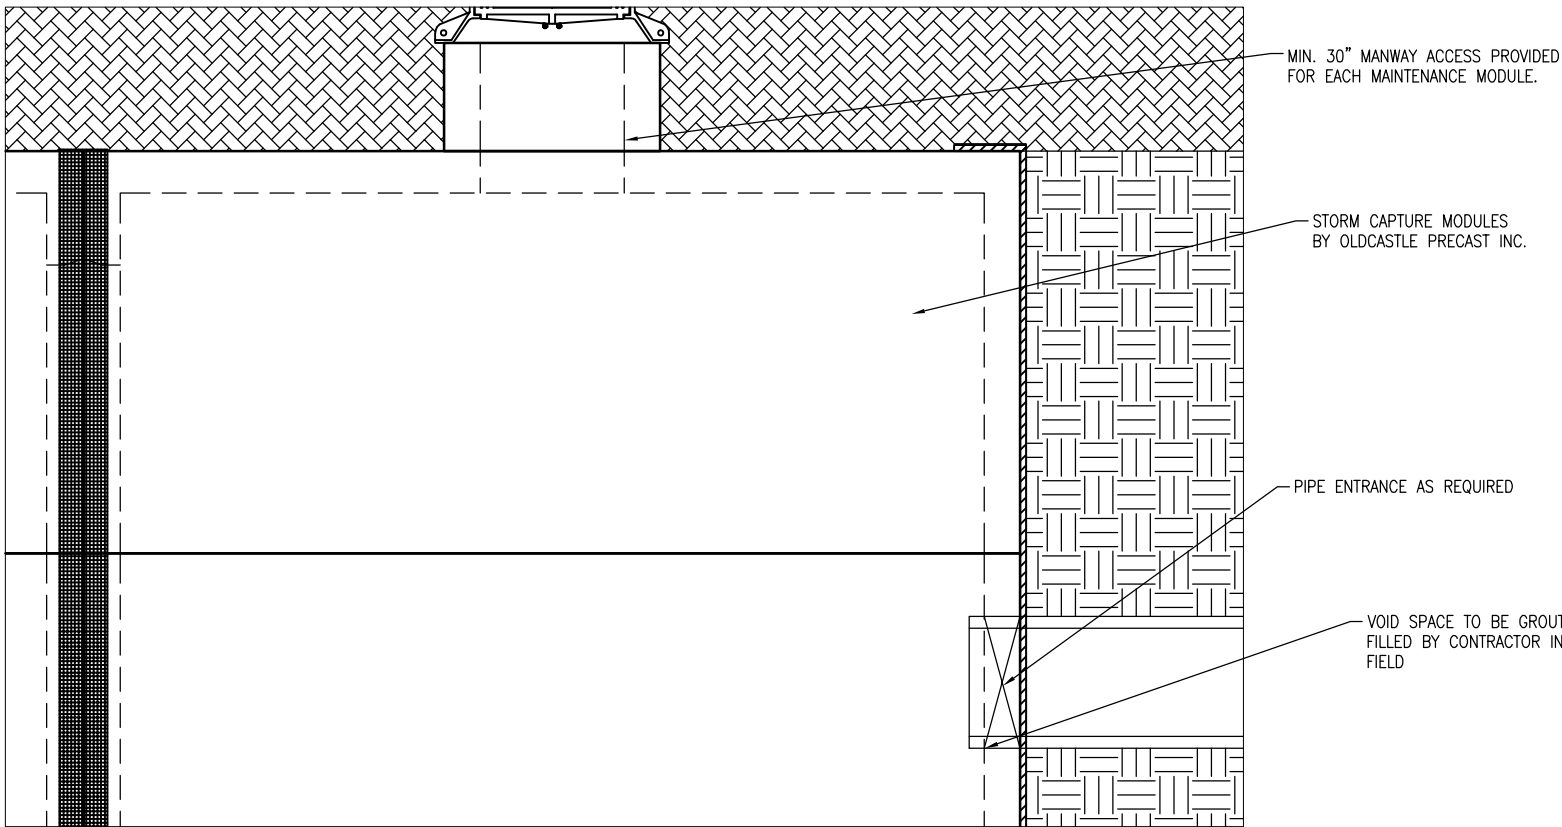

MANWAY ACCESS DETAIL  
SCALE: 3/8" = 1'-0"

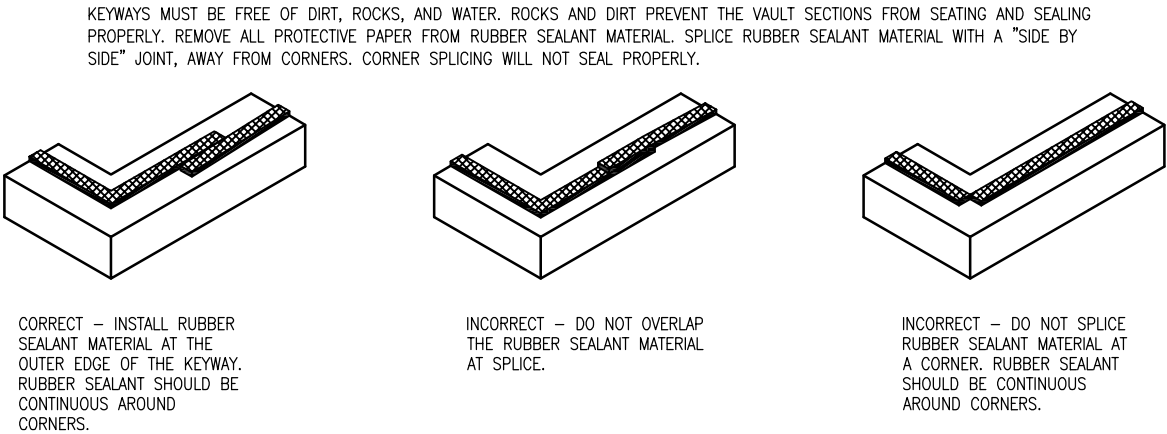

CONSEAL CS-102 BUTYL RUBBER SEALANT  
PLACEMENT DETAIL  
NTS

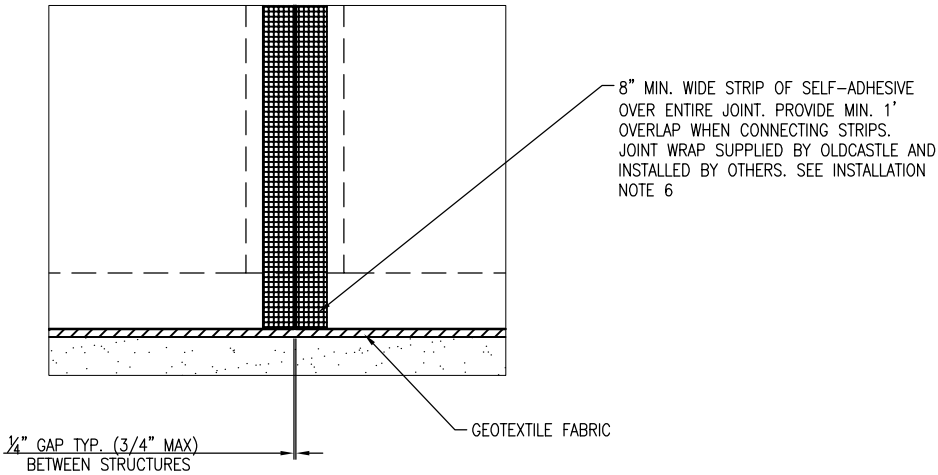

MODULE JOINT DETAIL  
SCALE: 1/2" = 1'-0"

- PRELIMINARY -  
NOT FOR CONSTRUCTION

**Oldcastle®**  
Stormwater Solutions


7821 SOUTHPARK PLAZA, SUITE 200, LITTLETON, CO 80120  
PHONE: 1-888-985-3227 FAX: 303-794-7497

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT ©2018 OLDCASTLE PRECAST, INC ALL RIGHTS RESERVED


**STORMCAPTURE**  
EXTERIOR DETAILS

CUSTOMER


DATE	SALES STS	DRAWN STS	ENGINEER JH	CHECKED	SALES ORDER
DRAWING NUMBER				REVISION	SHEET
SC2 - 13 ft clamshell				REV DATE	3 OF 4

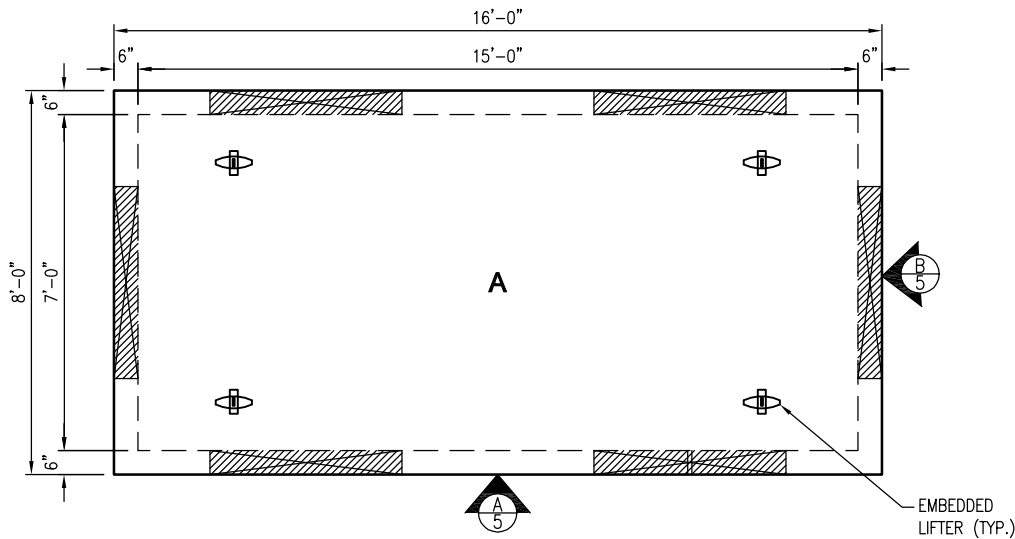


STORM CAPTURE PLAN VIEW  
SCALE: 1/4" = 1'-0"

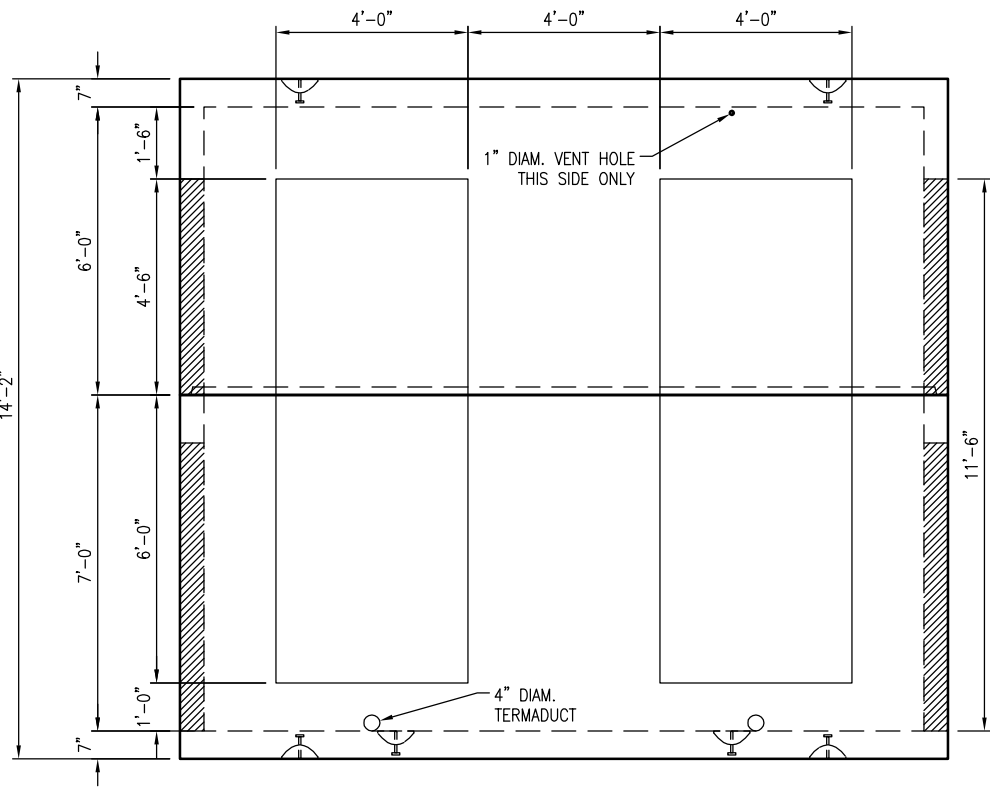


VIEW A  
SCALE: 1/4" = 1'-0"

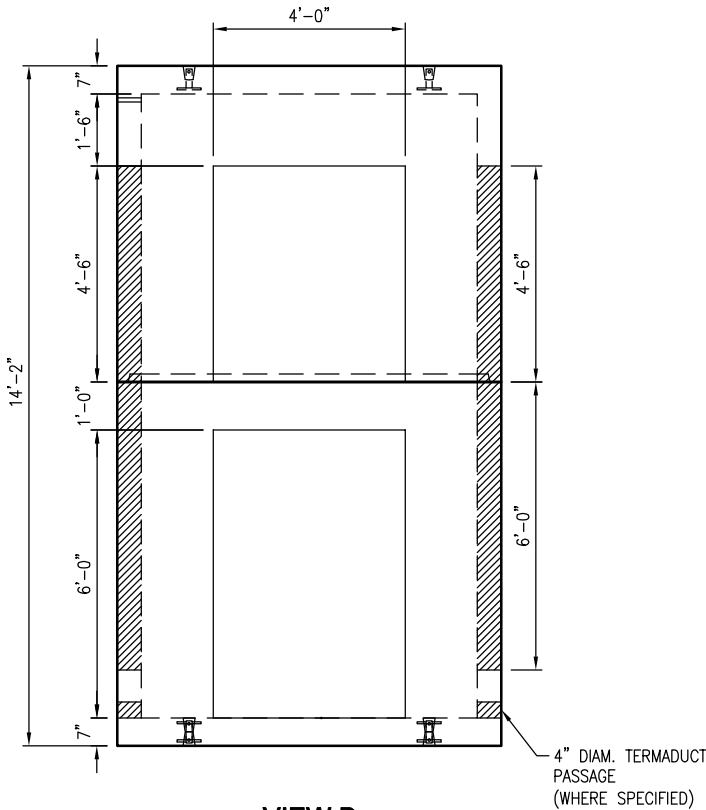

VIEW B  
SCALE: 1/4" = 1'-0"

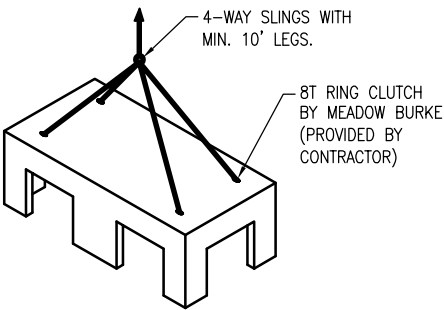

TOP MODULE LIFTING DETAIL  
N.T.S.

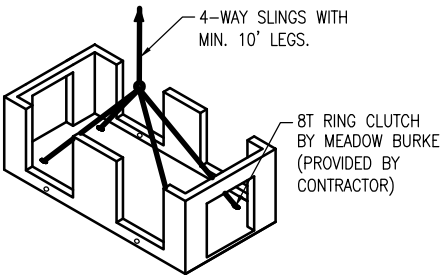

BOTTOM MODULE LIFTING DETAIL  
N.T.S.

- PRELIMINARY -  
NOT FOR CONSTRUCTION



THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT ©2016 OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED

STORMCAPTURE  
INTERIOR DETAILS

CUSTOMER					
DATE	SALES	DRAWN	ENGINEER	CHECKED	SALES ORDER
	STS	STS	JH		
DRAWING NUMBER				REVISION	SHEET
SC2 - 13 ft clamshell				REV DATE	4 OF 4