

GENERAL NOTES:

THE STORM CAPTURE™ SYSTEM BY OLDCASTLE PRECAST IS PART OF THE STORMWATER MANAGEMENT SYSTEM FOR THE RESPECTIVE SITE, AS PREPARED BY THE PROJECT DESIGN ENGINEER. IT IS THE RESPONSIBILITY OF THE DESIGN ENGINEER TO DETERMINE DESIGN FLOW RATES, PRE-TREATMENT AND POST-TREATMENT REQUIREMENTS, STORAGE VOLUME, AND ENSURE THE FINAL DESIGN MEETS ALL CONVEYANCE AND STORAGE REQUIREMENTS. SYSTEM DESIGN AND TYPE, SOIL ANALYSIS, LOADING REQUIREMENTS, COVER HEIGHT AND MODULE SIZE DETERMINE THE FOUNDATION TYPE AND REQUIREMENTS AS STATED HEREIN. ANY VARIATIONS FOUND DURING CONSTRUCTION FROM THE SITE AND SYSTEM ANALYSIS MUST BE REPORTED TO THE PROJECT DESIGN ENGINEER. THE PROJECT DESIGN ENGINEER IS RESPONSIBLE FOR OBTAINING A GEOTECHNICAL ENGINEERING REPORT VERIFYING THE BEARING CAPACITY STATED IN DESIGN NOTES.

DESIGN NOTES:

1. DESIGN LOADINGS:

A. AASHTO HS20-44 W/ IMPACT.

B. DEPTH OF COVER = 6" - 5'-0".

C. ASSUMED WATER TABLE = BELOW BOTTOM.

D. EQUIVALENT FLUID PRESSURE = 45 PCF.

E. LATERAL LIVE LOAD SURCHARGE = 80 PSF.

F. NO LATERAL SURCHARGE FROM ADJACENT STRUCTURES.

2. CONCRETE 28 DAY COMPRESSIVE STRENGTH SHALL BE 6,000 PSI.

3. STEEL REINFORCEMENT: REBAR, ASTM A-615, GRADE 60.

4. CEMENT: ASTM C-150 SPECIFICATION.

5. STORM CAPTURE MODULE TYPE = INFILTRATION.

6. DEPTH OF AGGREGATE BEARING LAYER TO BE DETERMINED IN ACCORDANCE WITH OLDCASTLE TECH NOTE SC-01.

7. ALLOWABLE SOIL BEARING PRESSURE ADDRESSED IN OLDCASTLE TECH NOTE SC-01.

8. REFERENCE STANDARDS:

A. ASTM C 890

B. ASTM C 891

C. ASTM C 913

9. LESS THAN 6" OR GREATER THAN 5' OF COVER REQUIRES CUSTOM STRUCTURAL DESIGN AND MAY REQUIRE THICKER AGGREGATE BEARING LAYER.
- INSTALLATION NOTES:
- THE STORM CAPTURE™ MODULE SYSTEM IS TO BE INSTALLED IN ACCORDANCE WITH ASTM C891, INSTALLATION OF UNDERGROUND PRECAST UTILITY STRUCTURES. PROJECT PLAN AND SPECIFICATIONS MUST BE FOLLOWED ALONG WITH ANY APPLICABLE REGULATIONS.

1. PLAN LINE, GRADE AND ELEVATIONS MUST BE FOLLOWED.

2. A. WHERE SPECIFIED, AN 8 OZ. NON-WOVEN GEOTEXTILE FABRIC MUST BE USED AS A SEPARATION LAYER AROUND THE STORM CAPTURE SYSTEM.

3. PENETRATIONS IN THE GEOTEXTILE MAY ONLY BE MADE WITH SMOOTH WALL PIPES. MAKE PENETRATIONS FOR ALL OUTLETS BEFORE MAKING PENETRATIONS FOR ANY INLETS.

4. THE AGGREGATE BEARING LAYER SHOULD CONSIST OF CLEAN, DURABLE CRUSHED AGGREGATE COMPACTED AS DIRECTED BY THE ENGINEER. OLDCASTLE RECOMMENDS MATERIALS SUCH AS NO. 56 OR NO. 57 STONE PER ASTM C33.

5. DESIGNATED EMBEDDED LIFTERS MUST BE USED. USE PROPER RIGGING TO ASSURE ALL LIFTERS ARE EQUALLY ENGAGED WITH A MINIMUM 60 DEGREE ANGLE ON SLINGS AS NOTED AND IN ACCORDANCE WITH OLDCASTLE LIFTING PROCEDURES.

6. MODULES MUST BE PLACED AS CLOSE TOGETHER AS POSSIBLE, AND GAPS SHALL NOT BE GREATER THAN 3/4". ALL EXTERIOR SYSTEM JOINTS SHALL BE COVERED WITH A MIN. 8" JOINT WRAP ON SIDES AND TOP (CS-212 CONSEAL OR EQUIVALENT). INSTALL ONE ROW CS-102 CONSEAL (OR EQUIVALENT) BETWEEN PRECAST PIECES.

7. AUTHORIZATION SHOULD BE GIVEN BY THE PROJECT ENGINEER OR DESIGNATED PERSON PRIOR TO PLACEMENT ON BACKFILL FOR THE SYSTEM. CARE SHOULD BE TAKEN DURING PLACEMENT OF BACKFILL NOT TO DISPLACE MODULES OR JOINT WRAP. BACKFILL SHALL BE COMPACTED TO 95% STANDARD PROCTOR DENSITY OR AS SPECIFIED, AND SHOULD NOT BE COMPACTED WITHIN 6" OF MODULE.


8. CONSTRUCTION EQUIPMENT EXCEEDING DESIGN LOADING SHALL NOT BE ALLOWED ON STRUCTURE.
- SPLASH PADS, INLETS AND RISERS:
- PLACE SPLASH PADS AS DESIGNATED TO PREVENT SCOUR FROM INLETS AND INLET PIPES. ALL PIPE INLETS SHALL EXTEND INSIDE MODULE A MINIMUM OF 4". PLACE A NON-SHRINK, NON-METALIC GROUT, MIN. 3,000 PSI IN ANNULAR SPACE TO ELIMINATE ALL VOIDS.
-
- TABLE OF CONTENTS
- | | |
|---------------------|---|
| NOTES & GENERAL ISO | 1 |
| TYPICAL ELEVATION | 2 |
| EXTERIOR DETAILS | 3 |
| INTERIOR DETAILS | 4 |
- NOTE: THIS VIEW IS FOR ILLUSTRATION PURPOSES ONLY TO SHOW FEATURES OF THE SYSTEM. ACTUAL LAYOUT VARIES BY PROJECT, SEE SITE PLAN LAYOUT. ALL PERIMETER WALLS ARE SOLID.
-
- INFILTRATION MODULE ISO VIEW
N.T.S.
- *THIS MUST BE FILLED OUT BEFORE MANUFACTURING BEGINS*
- APPROVED W/ NO EXCEPTIONS TAKEN: ☐

APPROVED AS NOTED: ☐

REVISE AND RESUBMIT: ☐
- PRELIMINARY -
NOT FOR CONSTRUCTION
- SIGNATURE

DATE
- 7821 SOUTHPARK PLAZA, SUITE 200, LITTLETON, CO 80120


PHONE: 1-888-965-3227 FAX: 303-794-7487
- THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT ©2016 OLDCASTLE PRECAST, INC ALL RIGHTS RESERVED
- STORMCAPTURE
NOTES & GENERAL ISO
- CUSTOMER
- | | | | | | |
|--------------------------------------|-----------|-----------|-------------|----------------------|-----------------|
| DATE | SALES STS | DRAWN STS | ENGINEER JH | CHECKED | SALES ORDER |
| DRAWING NUMBER
SC - 3 ft top-only | | | | REVISION
REV DATE | SHEET
1 OF 4 |

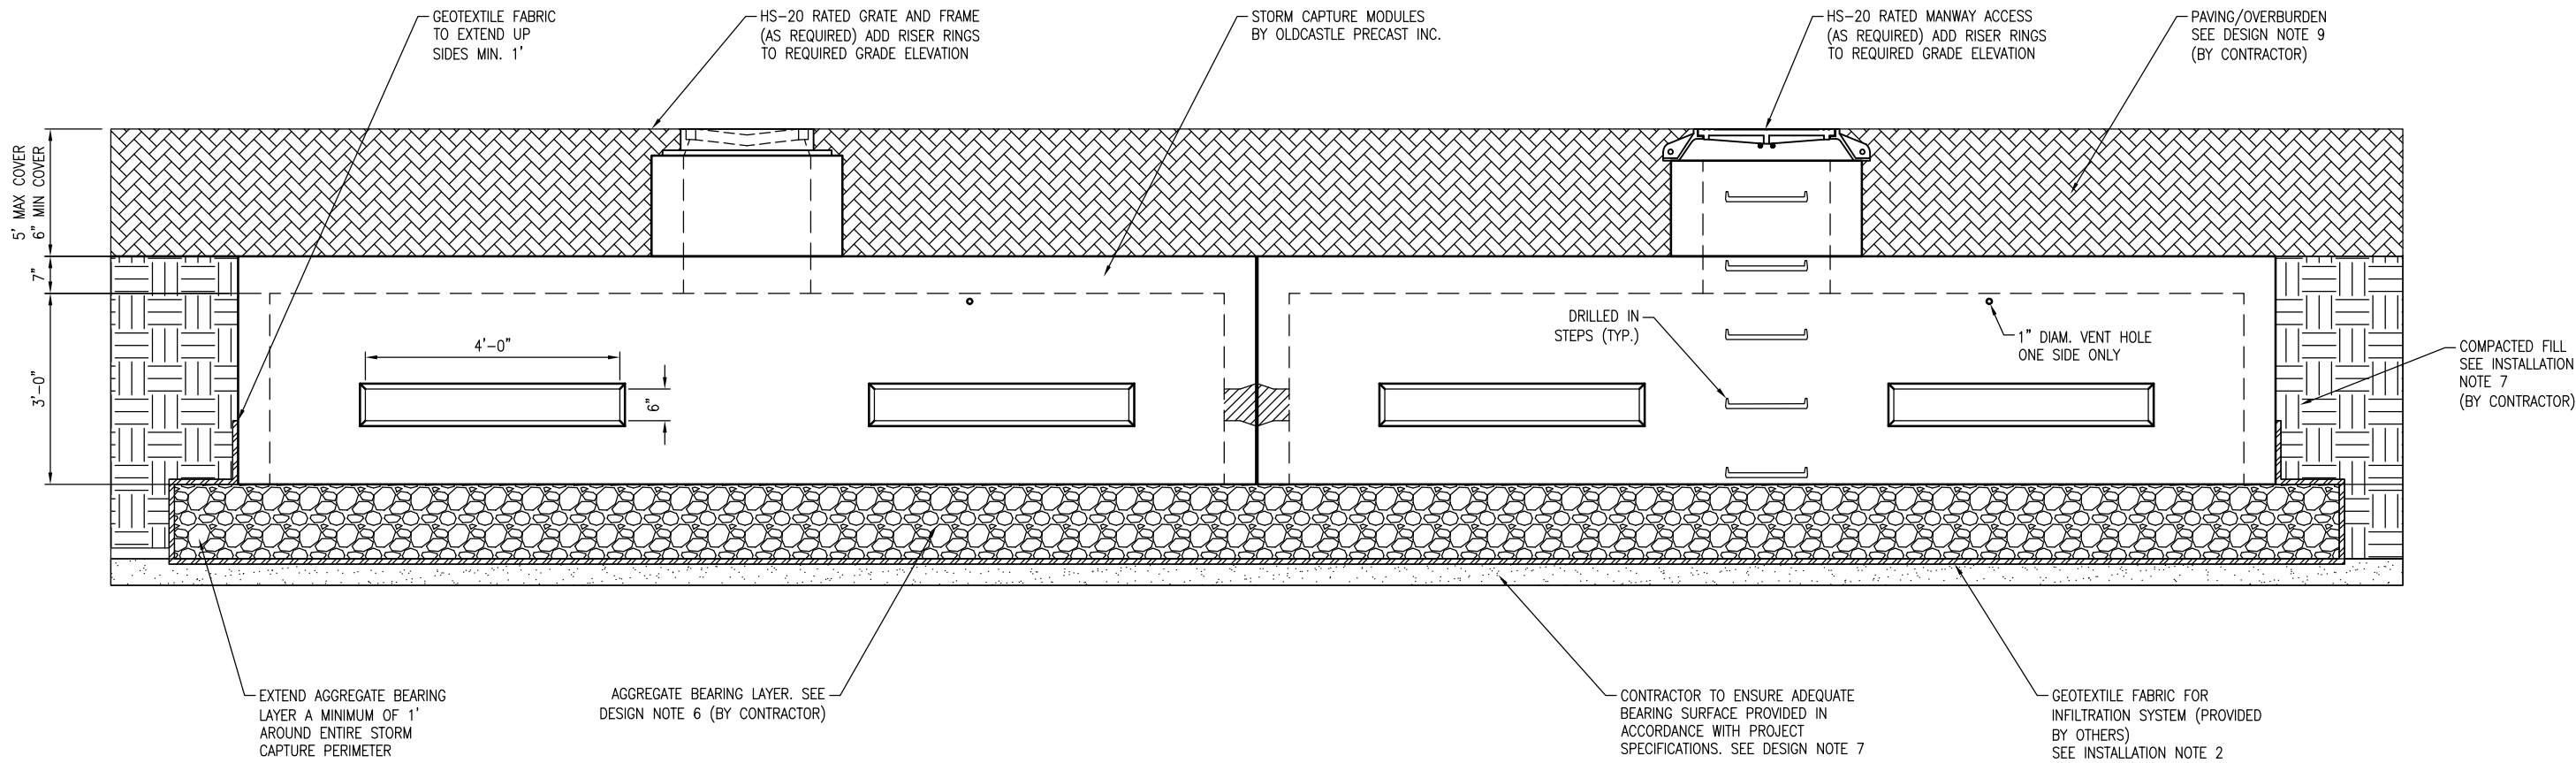

TYPICAL ELEVATION
SCALE: 3/8" = 1'-0"

NOTE:
FOR INFILTRATION - EXFILTRATION
SYSTEMS, THE AGGREGATE SUBGRADE
MUST BE WASHED AND CLEAN.

- PRELIMINARY -
NOT FOR CONSTRUCTION




7821 SOUTH PARK PLAZA, SUITE 200, LITTLETON, CO 80120
PHONE: 1-888-985-3227 FAX: 303-794-7487

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT ©2018 OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED

STORMCAPTURE
TYPICAL ELEVATION


CUSTOMER

DATE	SALES STS	DRAWN STS	ENGINEER JH	CHECKED	SALES ORDER
DRAWING NUMBER				REVISION	SHEET
SC - 3 ft top-only				REV DATE	2 OF 4

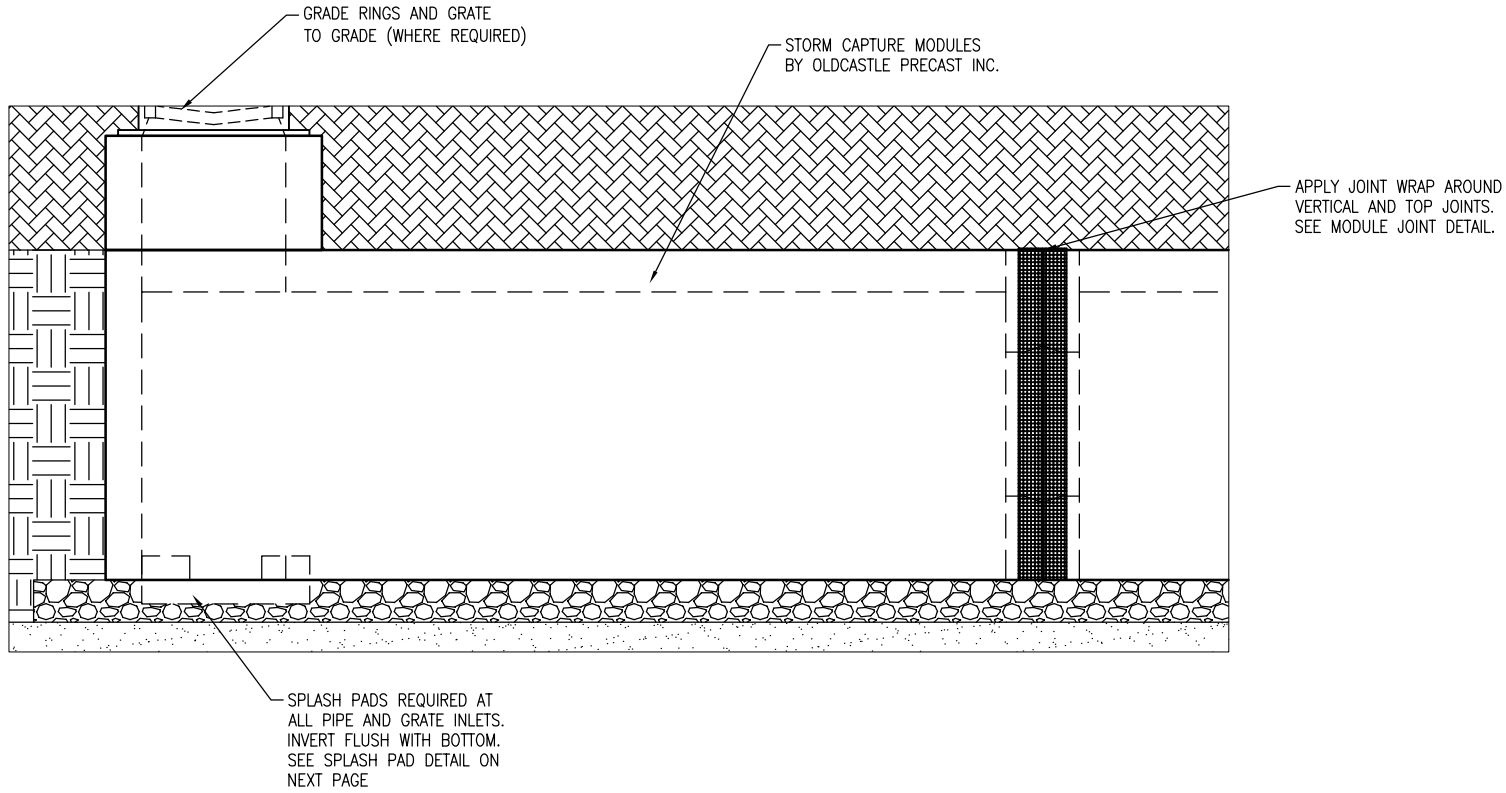


GRATE INLET DETAIL
SCALE: 3/8" = 1'-0"

NOTE: WEIR PLATES, IF REQUIRED, MAY BE INSTALLED WITH RED-HEAD ANCHORS (BY OTHERS). ELEVATIONS TO BE DETERMINED BY PROJECT DESIGN ENGINEER

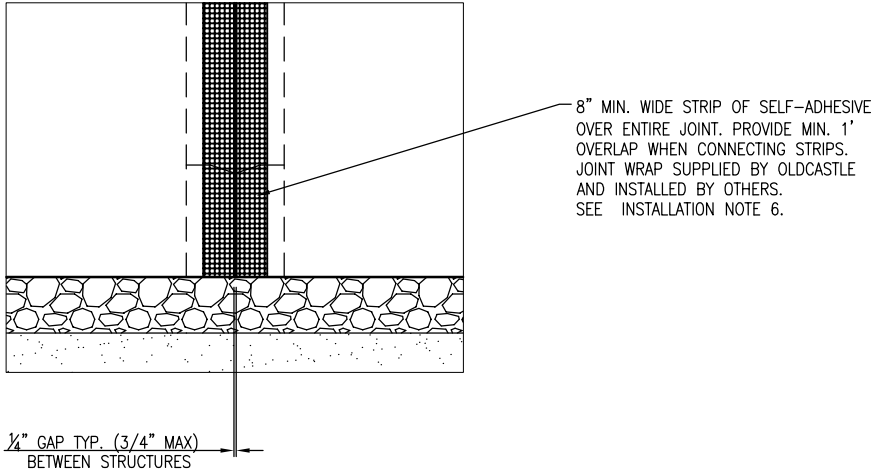

MODULE JOINT DETAIL
SCALE: 1/2" = 1'-0"

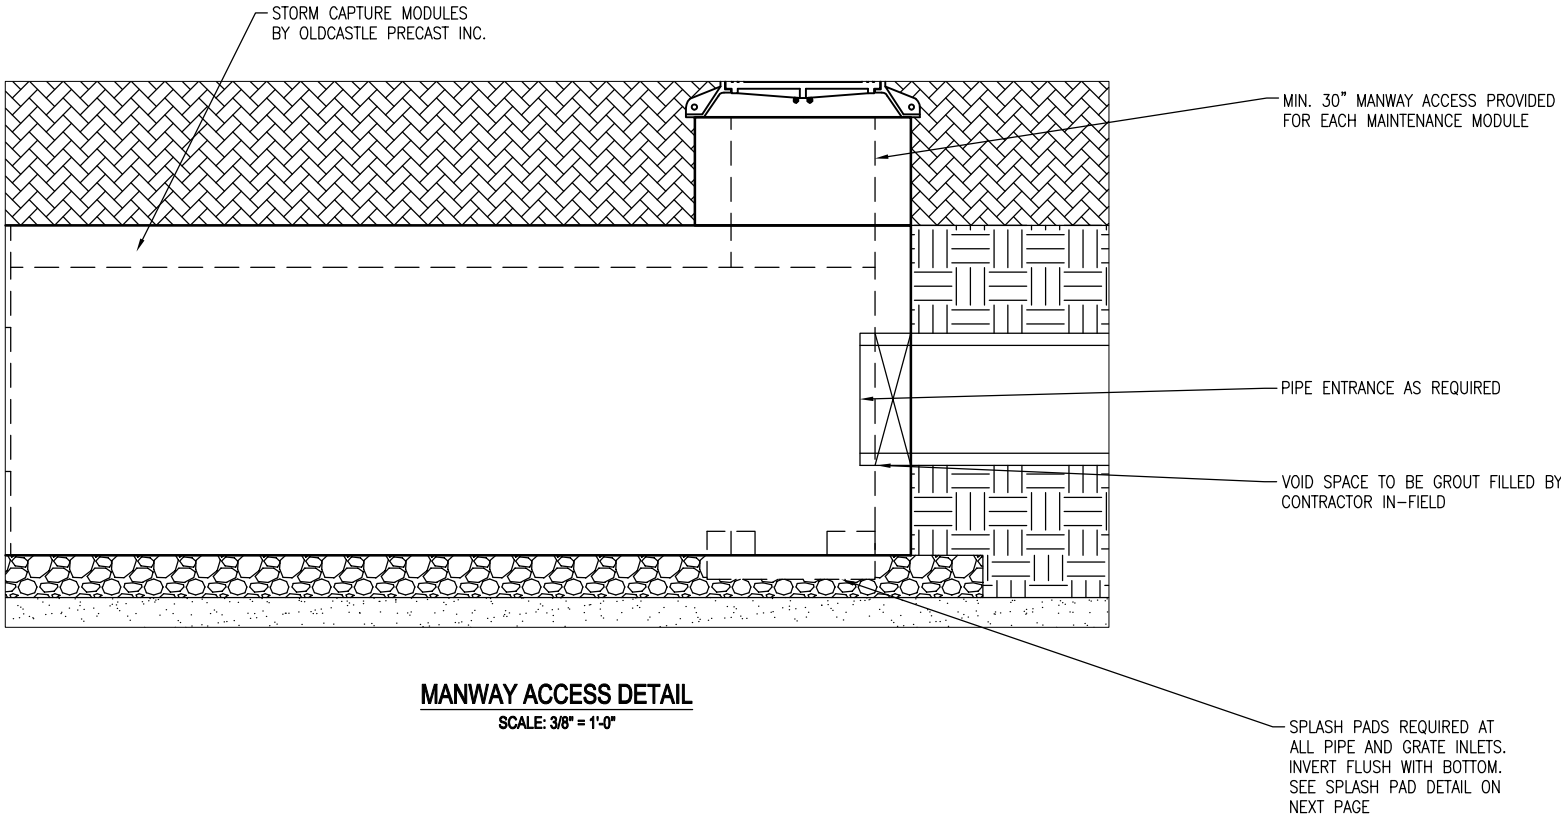

MANWAY ACCESS DETAIL
SCALE: 3/8" = 1'-0"

- PRELIMINARY -
NOT FOR CONSTRUCTION




THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT ©2018 OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED


STORMCAPTURE
EXTERIOR DETAILS

CUSTOMER


DATE	SALES STS	DRAWN STS	ENGINEER JH	CHECKED	SALES ORDER
DRAWING NUMBER				REVISION	SHEET
SC - 3 ft top-only				REV DATE	3 OF 4

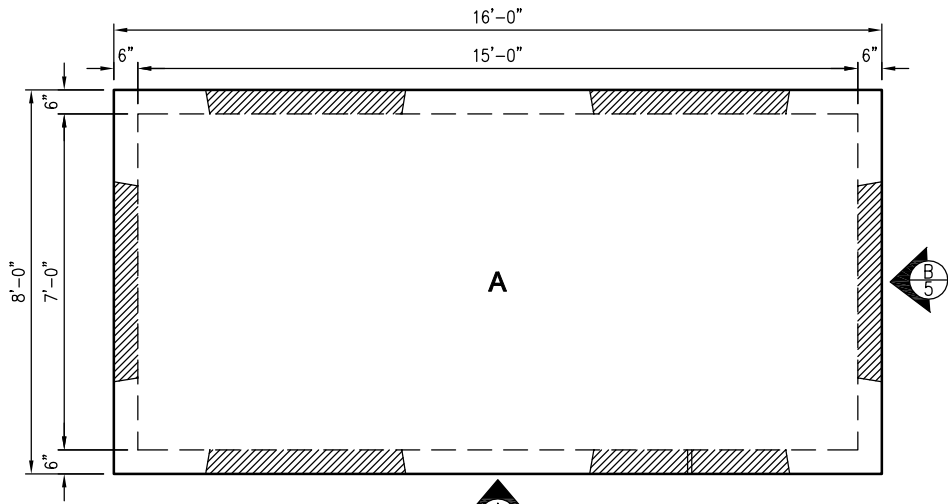


STORM CAPTURE PLAN VIEW
SCALE: 1/4" = 1'-0"

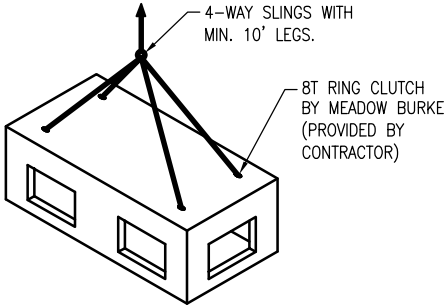


MODULE LIFTING DETAIL
N.T.S.

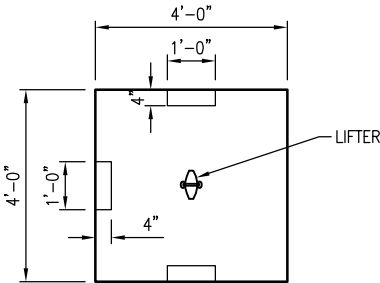


SPLASH PAD - PLAN
SCALE: 1/4" = 1'-0"



SPLASH PAD - PROFILE
SCALE: 1/4" = 1'-0"

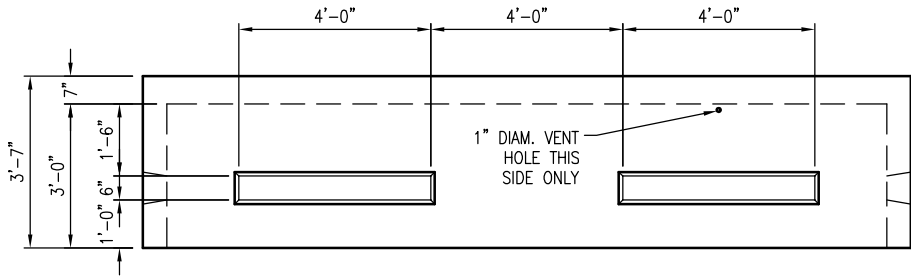

VIEW A
SCALE: 1/4" = 1'-0"

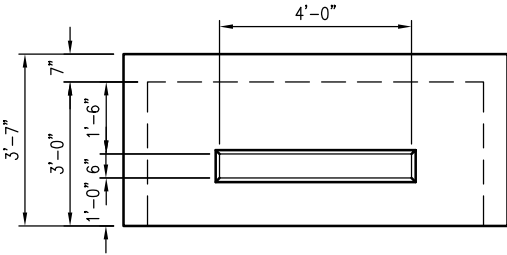

VIEW B
SCALE: 1/4" = 1'-0"

- PRELIMINARY -
NOT FOR CONSTRUCTION

Oldcastle®
Stormwater Solutions
7821 SOUTH PARK PLAZA, SUITE 200, LITTLETON, CO 80120
PHONE: 1-888-985-3227 FAX: 303-794-7497

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY, AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE PRECAST, INC. COPYRIGHT ©2018 OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED

STORMCAPTURE
INTERIOR DETAILS

CUSTOMER					
DATE	SALES STS	DRAWN STS	ENGINEER JH	CHECKED	SALES ORDER
DRAWING NUMBER SC - 3 ft top-only				REVISION REV DATE	SHEET 4 OF 4