ALL CONCRETE SHALL HAVE A 28 DAY COMPRESSIVE STRENGTH OF 4500 psi.


REINFORCING STEEL SHALL COMPLY WITH
ASTM A615 GRADE 60, A706 GRADE 60 OR A497 GRADE 70.
BAR BENDING AND PLACEMENT SHALL COMPLY WITH

THE LATEST ACI STANDARDS
WATER TABLE IS AT 3'-0" BELOW GRADE
FOR STANDARD STRUCTURAL DESIGN

THE STANDARD DESIGN IS BASED ON THE BASE AT ANY ELEVATION UP TO 40.0 FEET BELOW FINISHED GRADE.

THE STRUCTURE SHALL BE PLACED ON A COMPACTED GRANULAR BASE TO INSURE UNIFORM DISTRIBUTION OF SOIL PRESSURES.

SPECIAL DESIGNS BASED ON OTHER LOADINGS OR DEEPER INSTALLATION DEPTHS ARE AVAILABLE ON REQUEST.

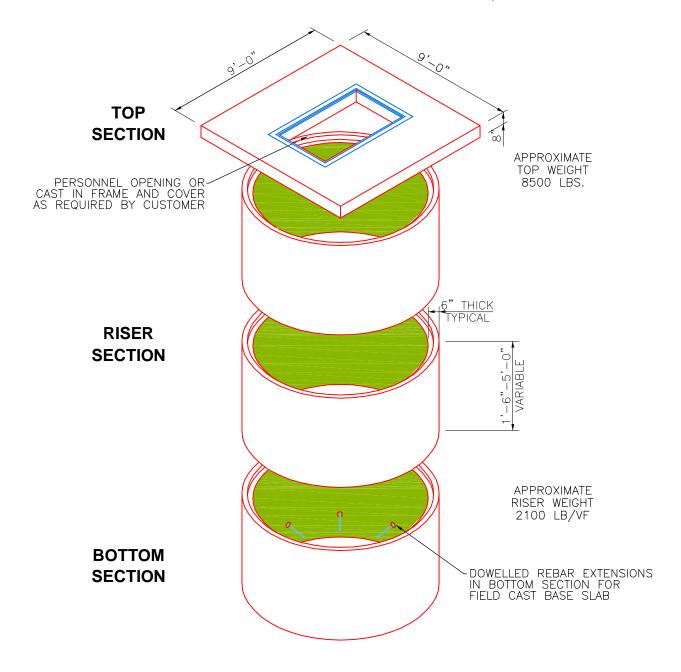



1900 Rilling Road San Antonio, TX 78214 Phone: (210) 923-4523 Fax: (210) 921-0473

W8D

FILE NAME: WWELL8.dwg ISSUE DATE: March, 2005

www.oldcastlesanantonio.com

8' DIAMETER WET WELL

Copyright 2005 O Oldcastle Proced All Rights Reserved