
ALL CONCRETE SHALL HAVE A 28 DAY COMPRESSIVE STRENGTH OF 4500 psi.

REINFORCING STEEL SHALL COMPLY WITH ASTM A615 GRADE 60, A706 GRADE 60 OR A497 GRADE 70.
BAR BENDING AND PLACEMENT SHALL COMPLY WITH THE LATEST ACI STANDARDS

WATER TABLE IS AT 3'-0" BELOW GRADE
FOR STANDARD STRUCTURAL DESIGN

THE STRUCTURE SHALL BE PLACED ON A COMPACTED GRANULAR BASE TO INSURE UNIFORM DISTRIBUTION OF SOIL PRESSURES.



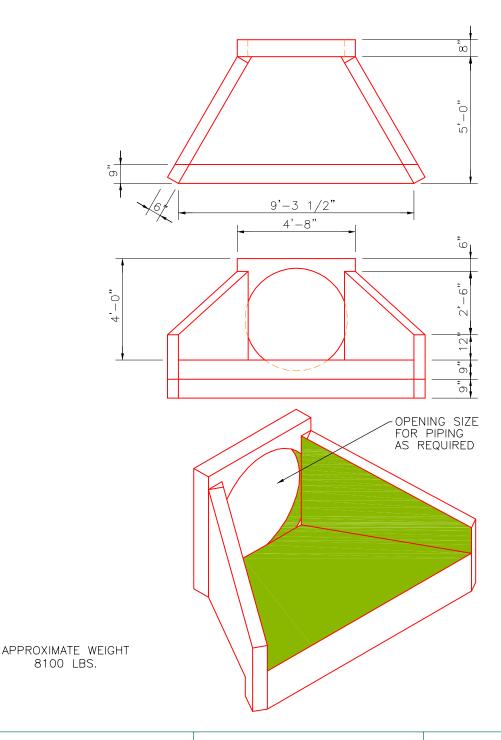

1900 Rilling Road San Antonio, TX 78214 Phone: (210) 923-4523 Fax: (210) 921-0473

WW36D

FILE NAME: HEADWAL4.dwg ISSUE DATE: March, 2005

www.oldcastlesanantonio.com

HEADWALL FOR 36" PIPE CULVERTS

Copyright 2005 Osicestic Proof All Rights Reserved