



- NOTES
1. CONCRETE - 5,000 P.S.I. MINIMUM STRENGTH @ 28 DAYS
 2. STEEL REINFORCEMENT - ASTM A-615, GRADE 60
 3. COVER TO STEEL - 1" MINIMUM
 4. VAULTS ARE DESIGNED TO MEET ASTM C857 AND ACI 318 WITH AASGTI HS-20 LOADING
 5. CONSTRUCTION JOINT - SEALED WITH BUTYL RUBBER RESIN OR EQUIVALENT

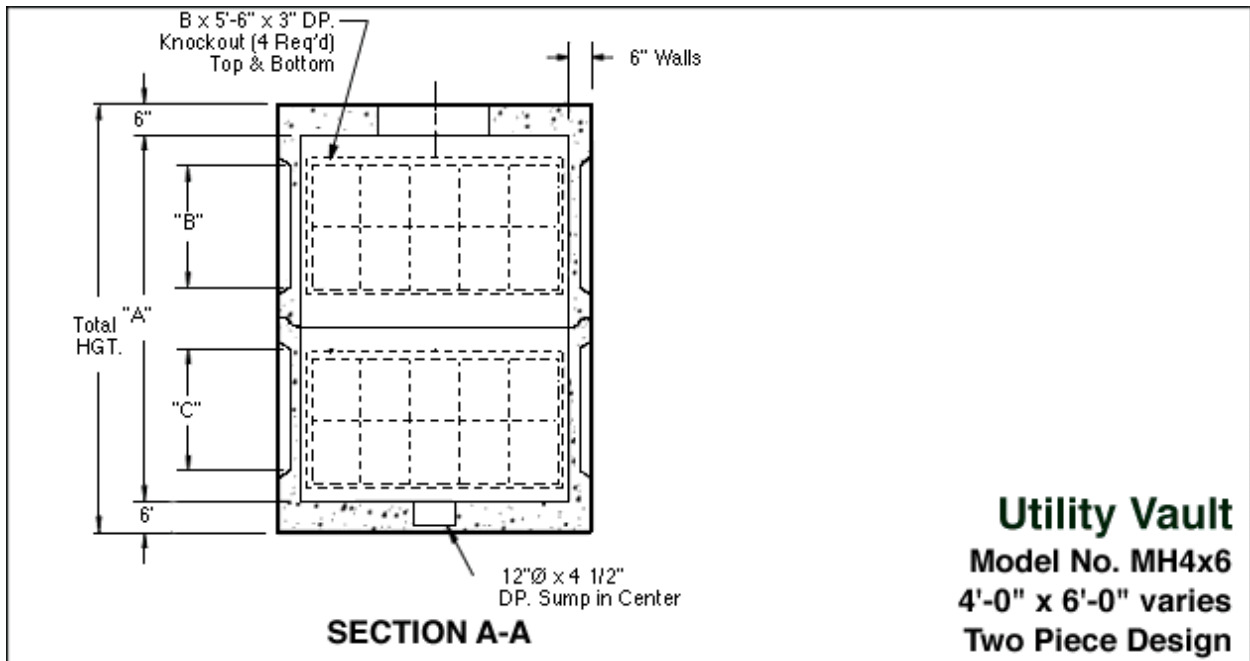

Utility Vault
Model No. MH4x6
4'-0" x 6'-0" varies
Two Piece Design

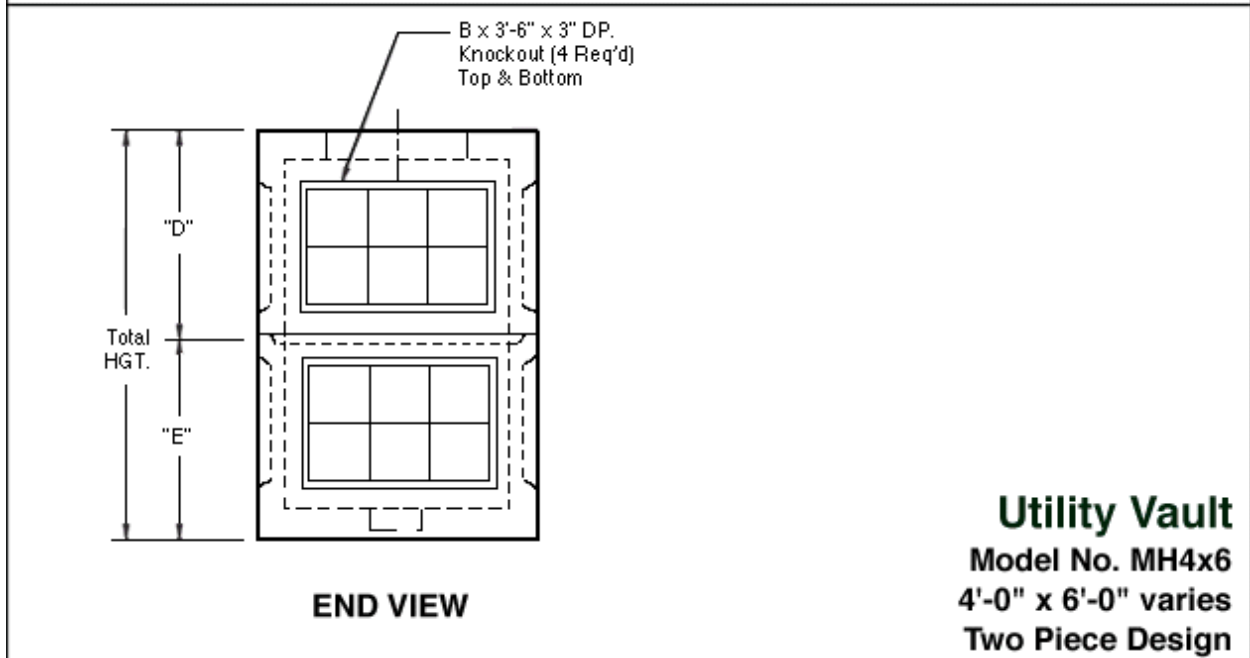

Utility Vault
Model No. MH4x6
4'-0" x 6'-0" varies
Two Piece Design