
	SITE S	PECIFIC	DATA	
Structure	ID			
Treatment Flow Rate (cfs)				-
Peak Flow Rate (cfs)				1.3 cfs
Rim Elevation				X.XX'
Pipe Data	Pipe Location	Pipe Size	Pipe Type	Invert Elevation
Outlet	XXX	XX"	XXX	X.XX'
Inlet	XXX	XX"	XXX	X.XX'
Notes:				
l _				

PERFORMANCE SPECIFICATIONS				
Treatment Flow Capacities:*				
NJDEP 80% Removal, 75 micron	0.054 cfs			
WA Ecology GULD - Basic & Phosphorus	0.030 cfs			
*Contact Oldcastle for alternative treatment flow capacities.				

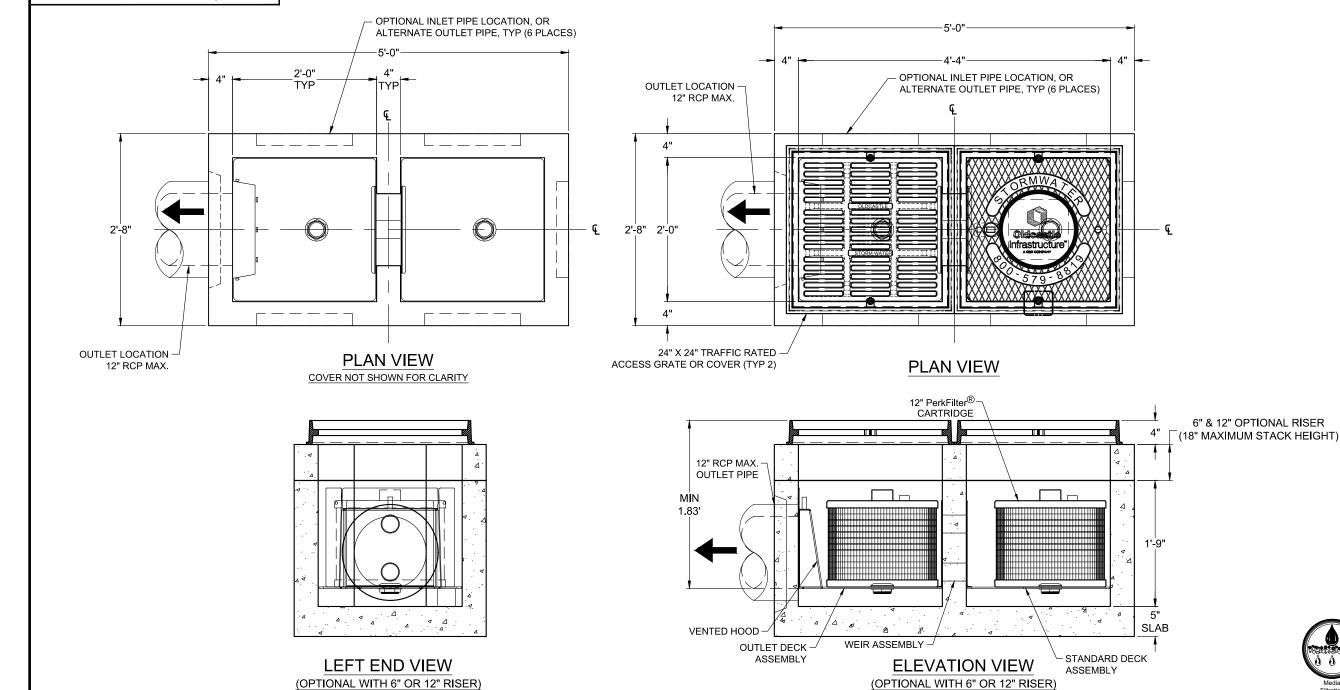

NOTES:

- DESIGN LOADINGS:
 A. AASHTO HS-20-44 W/ IMPACT.
 B. STANDARD DESIGN FILL: MAX TOP OF
 - C. ASSUMED WATER TABLE: BELOW STRUCTURE.
 - D. DRY LATERAL EARTH PRESSURE (EFP) = 45
 - E. LATERAL LIVE LOAD SURCHARGE = 80 PSF
 - (APPLIED TO 8' BELOW GRADE).

 F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
- 2. CONCRETE 28 DAY COMPRESSIVE STRENGTH SHALL BE 5,000 PSI MINIMUM.
- 3. STEEL REINFORCEMENT: REBAR, ASTM A-615 OR A-706, GRADE 60.
- 4. CEMENT: ASTM C-150 SPECIFICATION.
- 5. REQUIRED ALLOWABLE SOIL BEARING PRESSURE

CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).

- 6. REFERENCE STANDARD: A. ASTM C 890 B. ASTM C 913

 - C. ACI 318-14
- 7. OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS/CUSTOMER REQUIREMENTS. OUTLET LOCATIONS CAN BE CHANGED.
- 8. MAXIMUM PICK WEIGHT (COMBINED WEIGHT OF BASE, CARTRIDGE & ACCESS COVER) = TBD.
- 9. FOR SITE SPECIFIC DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT OLDCASTLE INFRASTRUCTURE.

- PRELIMINARY -NOT FOR CONSTRUCTION

