


	SITE S	PECIFIC	DATA	
Structure	ID			
Treatment Flow Rate (cfs)				-
Peak Flow Rate (cfs)				1.3 cfs
Rim Elevation				X.XX'
Pipe Data	Pipe Location	Pipe Size	Pipe Type	Invert Elevation
Outlet	XXX	XX"	XXX	X.XX'
Inlet	XXX	XX"	XXX	X.XX'
Notes:			•	


PERFORMANCE SPECIFICATIONS				
Treatment Flow Capacities:*				
NJDEP 80% Removal, 75 micron	0.108 cfs			
WA Ecology GULD - Basic & Phosphorus	0.060 cfs			
*Contact Oldcastle for alternative treatment flow capacities.				

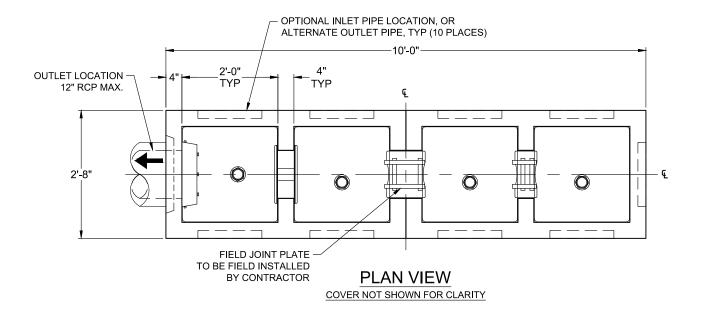

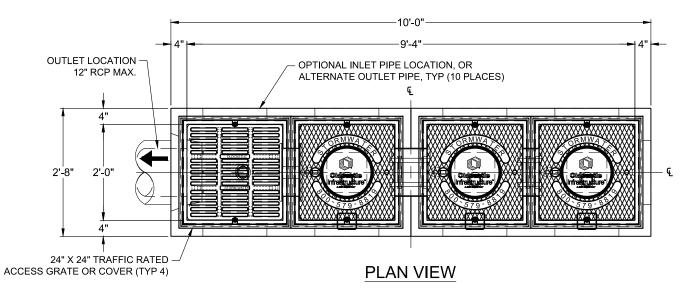

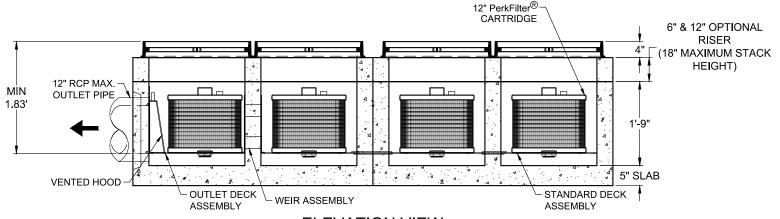

ELEVATION VIEW (OPTIONAL WITH 6" OR 12" RISER)



LEFT END VIEW
(OPTIONAL WITH 6" OR 12" RISER)



NOTES:

- 1. DESIGN LOADINGS:
- A. AASHTO HS-20-44 W/ IMPACT.
- B. STANDARD DESIGN FILL: MAX TOP OF STRUCTURE.
- C. ASSUMED WATER TABLE: BELOW STRUCTURE.
- D. DRY LATERAL EARTH PRESSURE (EFP) = 45
- E. LATERAL LIVE LOAD SURCHARGE = 80 PSF (APPLIED TO 8' BELOW GRADE).
- F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
- 2. CONCRETE 28 DAY COMPRESSIVE STRENGTH SHALL BE 5,000 PSI MINIMUM.
- STEEL REINFORCEMENT: REBAR, ASTM A-615 OR A-706, GRADE 60.
- 4. CEMENT: ASTM C-150 SPECIFICATION.
- 5. REQUIRED ALLOWABLE SOIL BEARING PRESSURE = 2,500 PSF.

CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).

- 6. REFERENCE STANDARD:
 - A. ASTM C 890
 - B. ASTM C 913 C. ACI 318-14
- OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS/CUSTOMER REQUIREMENTS. OUTLET LOCATIONS CAN BE CHANGED.
- 8. MAXIMUM PICK WEIGHT (COMBINED WEIGHT OF BASE, CARTRIDGE & ACCESS COVER) = TBD.
- 9. FOR SITE SPECIFIC DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT OLDCASTLE INFRASTRUCTURE.

- PRELIMINARY - NOT FOR CONSTRUCTION

