



Ø24.00" CAST IRON OR OPTIONAL
FIBERGLASS ACCESS COVER.



Ø18.00" CORRUGATED PVC OR HDPE
ACCESS RISER.




PLASTIC OR GEOTEXTILE FABRIC BOOT.
ATTACHED TO LINER PER MANUFACTURERS SPECIFICATION.




STAINLESS STEEL
CLAMP.

MAINTENANCE ACCESS ASSEMBLY.
FIELD POURED CONCRETE COLLAR
REQUIRED AROUND ALL ACCESS
COVERS, (NOT SHOWN), BY OTHERS.




LATERAL CUDO®
COUPLER.

INLET/OUTLET
PIPE CONNECTION
ASSEMBLY.

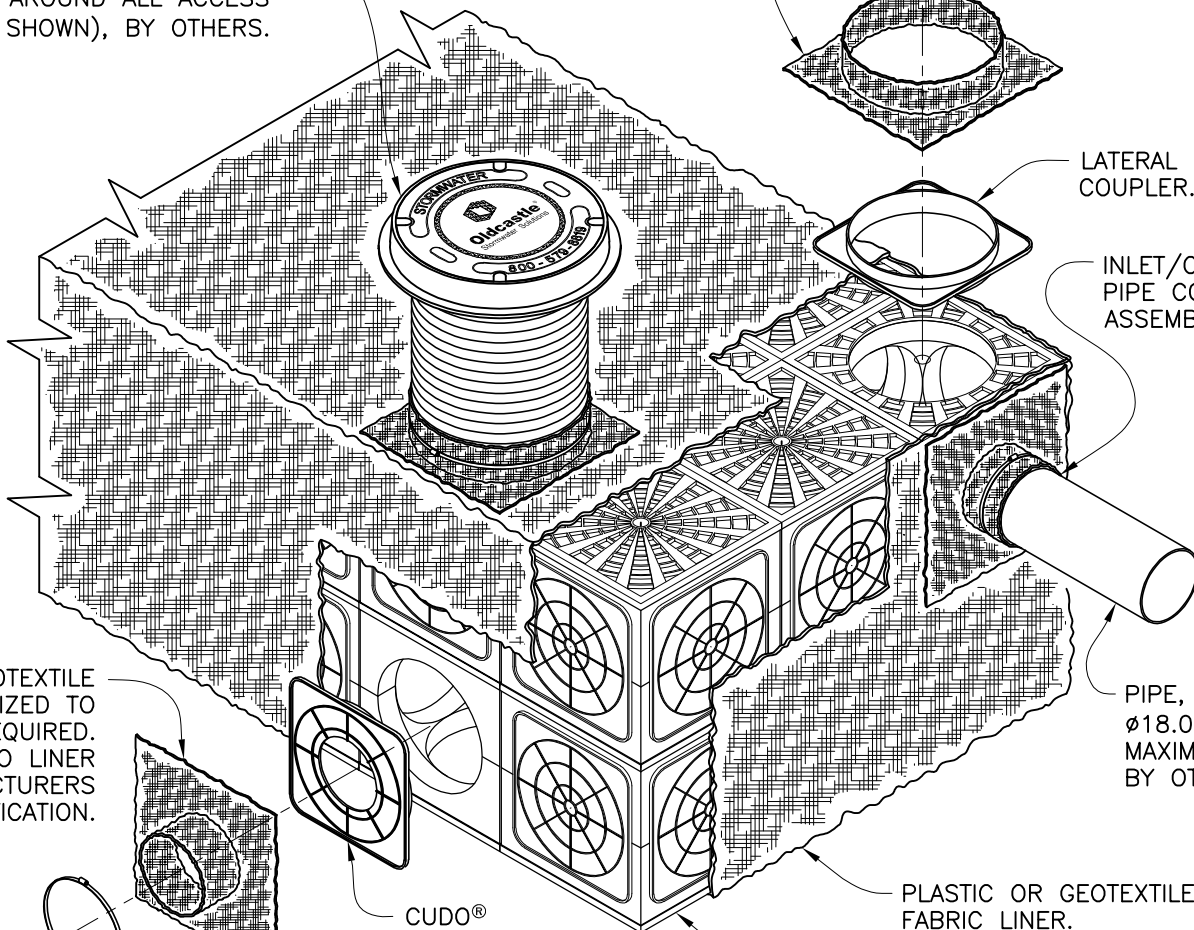

PLASTIC OR GEOTEXTILE
FABRIC BOOT SIZED TO
PIPE AS REQUIRED.
ATTACHED TO LINER
PER MANUFACTURERS
SPECIFICATION.


PIPE,
Ø18.00"
MAXIMUM.
BY OTHERS.



CUDO®
SIDE PANEL
WITH OPENING CUT
TO PIPE SIZE AS
REQUIRED. (Ø18.00" MAXIMUM)

PLASTIC OR GEOTEXTILE
FABRIC LINER.


CUDO™ WATER STORAGE SYSTEM.

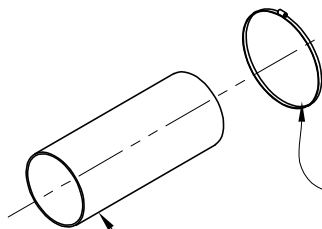

STAINLESS STEEL
CLAMP.

PIPE, Ø18.00" MAXIMUM.
BY OTHERS.

INLET / OUTLET CONNECTION
WITH PIPE



Detention/
Infiltration

CUDO®
Water Storage System
Pipe Connection & Maintenance
Access Installation Diagram



Oldcastle Infrastructure™
A CRH COMPANY

7921 Southpark Plaza, Suite 200 | Littleton, CO | 80120 | Ph: 800.579.8819 |

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS SUBMITTED FOR REFERENCE PURPOSES ONLY AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF SAID COMPANY. COPYRIGHT © 2018 OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED.

DRAWING NO.
CUDO-PIPE-0001

REV
B


ECO
ECO-0154
ZHD 2/6/18

DATE
JPR 7/22/09
SHEET 1 OF 2

Ø24.00" CAST IRON OR OPTIONAL
FIBERGLASS ACCESS COVER.




Ø18.00" CORRUGATED PVC OR HDPE
ACCESS RISER.




PLASTIC OR GEOTEXTILE FABRIC BOOT.
ATTACHED TO LINER PER MANUFACTURERS SPECIFICATION.


STAINLESS STEEL
CLAMP.




MAINTENANCE ACCESS ASSEMBLY.
FIELD POURED CONCRETE COLLAR
REQUIRED AROUND ALL ACCESS
COVERS, (NOT SHOWN), BY OTHERS.




LATERAL CUDO®
COUPLER.



INLET/OUTLET
ASSEMBLY.



Ø18.00" PLASTIC OR
GEOTEXTILE FABRIC BOOT.
ATTACHED TO LINER
PER MANUFACTURERS
SPECIFICATION.



Ø18.00" LATERAL
CUDO® COUPLER.




PLASTIC OR GEOTEXTILE
FABRIC LINER.

CUDO™ WATER STORAGE SYSTEM.

STAINLESS STEEL
CLAMP.

REDUCER/PIPE (Ø18.00" MAXIMUM)
BY OTHERS.

INLET / OUTLET CONNECTION
WITH REDUCER



Detention/
Infiltration

CUDO®
Water Storage System
Pipe Connection & Maintenance
Access Installation Diagram



Oldcastle Infrastructure™
A CRH COMPANY

7921 Southpark Plaza, Suite 200 | Littleton, CO | 80120 | Ph: 800.579.8819 |

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE PRECAST, INC. IT IS SUBMITTED FOR REFERENCE PURPOSES ONLY AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF SAID COMPANY. COPYRIGHT © 2018 OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED.

DRAWING NO.
CUDO-PIPE-0001

REV
B

ECO
ECO-0154
ZHD 2/6/18

DATE
JPR 7/22/09

SHEET 2 OF 2